

Humidification Load Calculation Manual

Engineering Manual

Includes What is Humidity, Affects of Relative Humidity, Calculating Relative Humidity, Requirements to Calculate Humidifier Load, and Load Calculations

Liability Notice

Nortec does not accept any liability for installations of humidity equipment installed by unqualified personnel or the use of parts/components/equipment that are not authorized or approved by Nortec.

Copyright Notice


Copyright 2009, WALTER MEIER LTD. All rights reserved.

Contents

| | |
|-----------|--|
| 5 | What is Humidity |
| 6 | Effects of Relative Humidity |
| 6 | Static Electricity |
| 7 | Moisture Stability |
| 8 | Health and Comfort |
| 10 | Calculating Relative Humidity |
| 12 | Requirements to Calculate Humidification Load |
| 12 | Design Conditions – Selecting an RH Setpoint |
| 16 | Outdoor Air Conditions |
| 22 | Load Calculations |
| 22 | Natural Ventilation |
| 23 | Mixed Air System |
| 23 | Makeup or Exhaust Air System |

What is Humidity

If a closed container is partially filled with water, then some of the water molecules in the liquid will leave the surface of the water and become vapor. Once some water molecules are present as vapor they will also re-enter the liquid. After some time at constant temperature equilibrium will be reached where the same number of molecules are leaving and entering the liquid. At

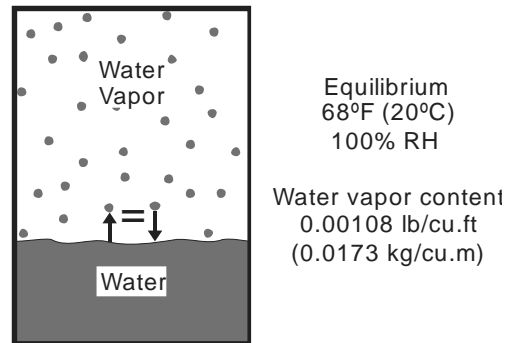

this equilibrium point the relative humidity of the water vapor is 100%.

Figure 1: Water Vapour Equilibrium

Relative humidity (RH) is the percentage of water vapour present in the air relative to the amount that would be present in the equilibrium state.



The equilibrium point is temperature dependent. At higher temperatures the equilibrium occurs with more water vapor. If the container above was heated to 86°F (30°C) the water and water vapor would no longer be in equilibrium. The relative humidity of the vapor right after increasing the temperature would be 57%. This means that immediately after heating there are 57% as many water vapor molecules as would be present in the equilibrium state.

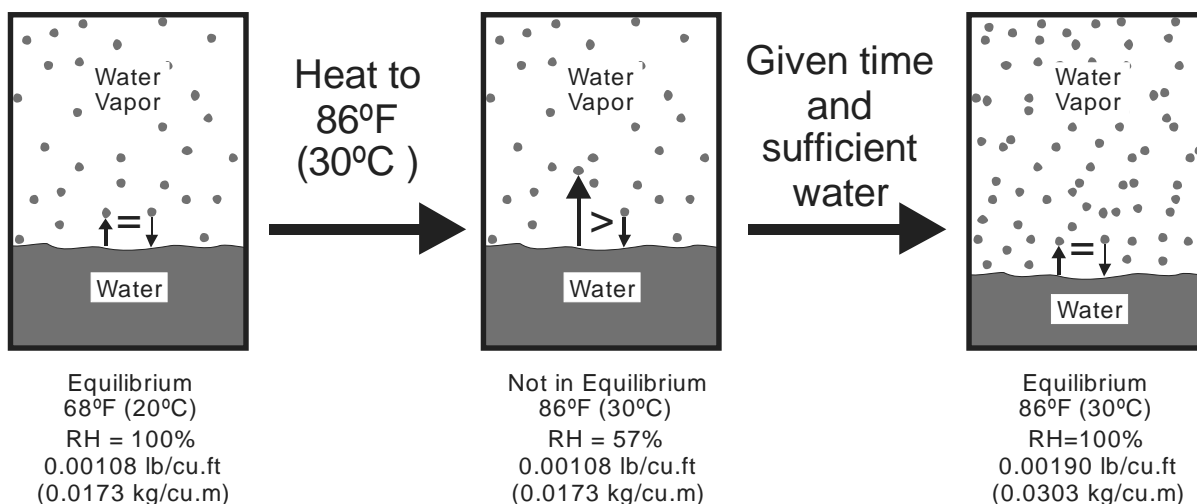


Figure 2: Relative Humidity after Heating

It is the above process that causes dry air in buildings. As cold incoming air is heated, its relative humidity value drops. Therefore moisture must be added to attain an acceptable level of humidity within the building.

Load Calculations - on page 22 outlines how to calculate the amount of moisture that must be added to maintain a constant relative humidity.



Effects of Relative Humidity

The reasons for humidifying dry air vary from one building to another and from one geographic area to another, however there are three fundamental reasons. These are:

- Static Electricity
- Poor Moisture Stability
- Health and Comfort

Static Electricity

Static electricity is a condition caused by stationary charges of electricity and is a major problem in most unhumidified areas. Since static electricity is caused by friction, particularly when the elements in friction are dry, the problem increases proportionately with the speed of production machinery. Without sufficient humidification, high-speed machinery might well defeat its own purpose. Reduced efficiency is frequently the result of static electricity.

In the **printing industry** presses must self-feed paper evenly, one sheet at a time at very high speeds. When the static electricity causes sheets of paper to stick together, the paper bunches, the feeding becomes uneven, and eventually the paper jams the presses.

In the **textile industry** static electricity causes the yarns to adhere to each other, the shuttles miss threads and improper weaving patterns result.

In **offices**, static electricity can disrupt operations and increase operating costs. In many photocopiers, sheets of paper stick together and jam the machine, wasting time and paper. Severely jammed equipment may even require service calls.

In **computer rooms and data processing areas**, the lack of humidity results in static electricity that causes problems such as circuit board failure, dust buildup on heads, and storage tape breakage.

Static electricity can also be dangerous. Sparks caused by static are extremely hazardous in locations such as **hospital operating rooms** where flammable gases are present. Many flash fires – even explosions – are caused by static electricity.



Controlling Static Electricity - Maintaining relative humidity above 35% is one important measure that can be taken to reduce static electricity.

Controlling Static Electricity

One of the easiest and most common methods of minimizing static electricity is to increase the relative humidity level. Electrostatic charges do not dissipate through moist air, but through a moisture film that is absorbed on the charged surfaces. This moisture film decreases the surface resistance and causes static charges to be drained.

This effect is most pronounced at RH above 30-35% and it also corresponds with a decrease in ozone production (a by-product of electrostatic discharge). Static electricity is a problem that should be of primary concern to any manufacturing plant interested in running efficiently and accurately.

Moisture Stability

When air is heated the relative humidity will decrease. When this occurs the rate at which water molecules leave objects containing water or the rate at which water evaporates is increased. All hygroscopic or fibrous materials either lose or gain moisture in direct relation to the relative humidity of the surrounding air

Moisture stability is the ability of a material to maintain a level of moisture content despite fluctuations in the humidity of the environment. Many materials give off, or take on moisture rapidly which can result in serious damage to the material or the process in which it may be involved. The drying out of a material can result in product deterioration, while conversely, a dry material can also suffer damaging side effects of moisture regain. In many cases, product deterioration is directly related to the lack of moisture stability

Table 1 gives the hygroscopic regain of some common hygroscopic materials. Hygroscopic regain is defined as the amount of water a completely dry material will absorb from the air. It is expressed as a percent of the dry weight. (For example the weight of completely dry timber will increase by 9.3% if it is stored at an RH of 50%)

Table 1: Hygroscopic Regain of Some Common Materials

| Industry and/or Material | Relative Humidity - % | | | | | | | | |
|---------------------------------------|-----------------------|------|------|------|------|------|------|------|------|
| | 10 | 20 | 30 | 40 | 50 | 60 | 70 | 80 | 90 |
| Baking | | | | | | | | | |
| Crackers | 2.1 | 2.8 | 3.3 | 3.9 | 5 | 6.5 | 8.3 | 10.9 | 14.9 |
| Flour | 2.6 | 4.1 | 5.3 | 6.5 | 8 | 9.9 | 12.4 | 15.4 | 19.1 |
| White Bread | 0.5 | 1.7 | 3.1 | 4.5 | 6.2 | 8.5 | 11.1 | 14.5 | 19 |
| Leather - Sole Oak, Tanned | 5 | 8.5 | 11.2 | 13.6 | 16 | 18.3 | 20.6 | 24 | 29.2 |
| Printing | | | | | | | | | |
| Paper - Comm. Ledger - 75% Rag 1% Ash | 3.2 | 4.2 | 5 | 5.6 | 6.2 | 6.9 | 8.1 | 10.3 | 13.9 |
| Paper M.F. Newsprint - 24% Ash | 2.1 | 3.2 | 4 | 4.7 | 6.1 | 7.2 | 8.7 | 10.6 | |
| Paper White Bond Rag - 1% Ash | 2.4 | 3.7 | 4.7 | 5.5 | 6.5 | 7.5 | 8.8 | 10.8 | 13.2 |
| Paper Writing - 3% Ash | 3 | 4.2 | 5.2 | 6.2 | 7.2 | 8.3 | 9.9 | 11.9 | 14.2 |
| Textile | | | | | | | | | |
| Cotton - Absorbent | 4.8 | 9 | 12.5 | 15.7 | 18.5 | 20.8 | 22.8 | 24.3 | 25.8 |
| Cotton - American-cloth | 2.6 | 3.7 | 4.4 | 5.2 | 5.9 | 6.8 | 8.1 | 10 | 14.3 |
| Cotton - Sea Isle-roving | 2.5 | 3.7 | 4.6 | 5.6 | 6.6 | 7.9 | 9.5 | 11.5 | 14.1 |
| Hemp - Manila and Sisal | 2.7 | 4.7 | 6 | 7.2 | 8.5 | 9.9 | 11.6 | 13.6 | 15.7 |
| Jute - Average Grade | 3.1 | 5.2 | 6.9 | 8.5 | 10.2 | 12.2 | 14.4 | 17.1 | 20.2 |
| Linen - Dried Spun - Yarn | 3.6 | 5.4 | 6.5 | 7.3 | 8.1 | 8.9 | 9.8 | 11.2 | 13.8 |
| Rayon - Celulose - Acetate - Fibre | 0.8 | 1.1 | 1.4 | 1.9 | 2.4 | 3 | 3.6 | 4.3 | 5.3 |
| Rayon - Cupramonium - Average Skein | 4 | 5.7 | 6.8 | 7.9 | 9.2 | 10.8 | 12.4 | 14.2 | 10 |
| Rayon - Viscose Nitrocel | 4 | 5.7 | 6.8 | 7.9 | 9.2 | 10.8 | 12.4 | 14.2 | 16 |
| Silk - Raw Chevennes-Skein | 3.2 | 5.5 | 6.9 | 8 | 8.9 | 10.2 | 11.9 | 14.3 | 18.8 |
| Wool - Australian-Marino-Skein | 4.7 | 7 | 8.9 | 10.8 | 12.8 | 14.9 | 17.2 | 19.9 | 23.4 |
| Tobacco - Cigarette | 5.4 | 8.6 | 11 | 13.3 | 16 | 19.5 | 25 | 33.5 | 50 |
| Wood | | | | | | | | | |
| Timber - Average | 3 | 4.4 | 5.9 | 7.6 | 9.3 | 11.3 | 14 | 17.5 | 22 |
| Glue - Hide | 3.4 | 4.8 | 5.8 | 6.6 | 7.6 | 9 | 10.7 | 11.8 | 12.5 |
| Miscellaneous | | | | | | | | | |
| Charcoal-Steam Activated | 7.1 | 14.3 | 22.8 | 26.2 | 28.3 | 29.2 | 30 | 31.1 | 32.7 |
| Gelatin | 0.7 | 1.6 | 2.8 | 3.8 | 4.9 | 6.1 | 7.6 | 9.3 | 11.4 |
| Silica Gel | 5.7 | 9.8 | 12.7 | 15.2 | 17.2 | 18.6 | 20.2 | 21.5 | 22.6 |
| Soap | 1.9 | 3.8 | 5.7 | 7.6 | 10 | 12.9 | 16.1 | 19.8 | 23.8 |
| Starch | 2.2 | 3.8 | 5.2 | 6.4 | 7.4 | 8.3 | 9.2 | 10.6 | 12.7 |

NOTE: Moisture content expressed in per cent of dry weight of the substance at various relative humidities - Temperature 75 °F (22°C)



Hygroscopic Regain – is defined as the amount of water a completely dry material will absorb from the air. . Any hygroscopic product that is purchased and sold by weight must have a carefully controlled environment.

Products such as **vegetable, cut flowers, fruit** and many grocery items cannot be brought back to original quality once they have lost their moisture. By installing an efficient humidification system this costly loss of products can be avoided. Many food processors humidify their plant and storage areas and are able to store fruits and vegetables for months without any loss of product quality or weigh.

For any product that requires a certain percentage of moisture to maintain its quality, loss of that moisture reduces its value. Some products can be brought back to their original condition by returning the moisture to them. However, among those that cannot reabsorb moisture to regain their lost quality are fruit and vegetable products, paintings and art objects.

Deterioration caused by loss of moisture is also a problem for treasures such as **antiques, rare books, and works of art**, all of which are susceptible to damage caused by moisture loss. It causes antiques, paintings, paper and book bindings to crack, warp and deteriorate. Fortunately, most libraries and museums are well aware of the need for controlled humidity to protect their collections. They know that proper humidity control is a very inexpensive preventive measure that will avoid costly and often impossible restorations.

A specific moisture content in materials is essential to the quality of products produced by a wide range of manufacturers of hygroscopic or fibrous materials. **Wood, paper and textiles** are examples of materials particularly affected by changes in content. If these materials have a correct moisture content when they arrive at a plant, and if they are used immediately, they will respond properly to the manufacturing process. But problems can be anticipated if the materials are stored in a dry atmosphere.

Paper provides a good example of the effects of dry air and the lack of moisture stability. When it is stored under dry atmospheric conditions, moisture from the outer layers and edges of the stacks escapes into the air. The moisture loss is much more rapid from the outer edges than from the center of the stacks. The result is not only curled stock, but also uneven moisture content, which creates printing and processing problems.

If moisture stability in the surrounding atmosphere is the answer to a **manufacturing operation**, then complete humidification of the plant and storage areas is an absolute necessity. Humidification is the best and least expensive way of maintaining moisture stability. If the air surrounding the material is maintained at a proper and constant relative humidity level, so that no moisture is emitted or absorbed by the materials, then the products will remain stable in both moisture content and dimension.

Ideally, humidification equipment should be installed in raw material storage areas, manufacturing facilities, and finished goods' storage rooms, for full control of the product moisture content.

Health and Comfort

During the heating season, inside air dries to the point where the humidity is substantially lower or comparable to that of the Sahara Desert. The effect on people is to dry out nasal and throat membranes. For employees this means more susceptibility to colds and virus infections. The subsequent increased absenteeism proves costly for any employers. Another aspect of comfort

is the fact that humidity in the air makes a room feel warmer, so there will be fewer requests to have the thermostat turned up.

Most employers provide air conditioning for employee comfort and productivity during the hot days of summer. Adding humidification for full winter comfort and productivity is just as important as air conditioning in the summer months. In fact, it is one of the most important functions of the complete air conditioning or “total comfort” system.

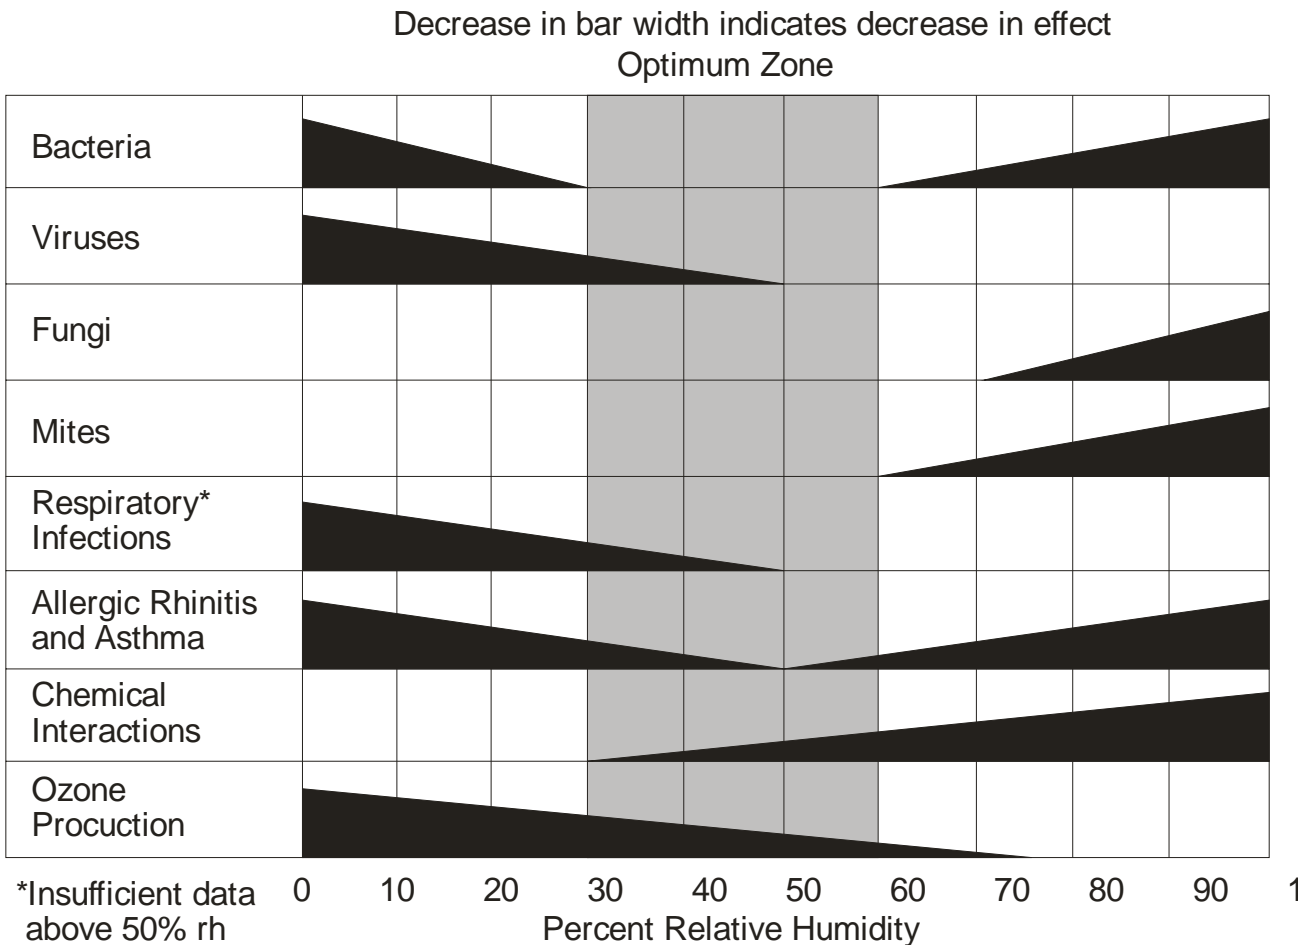


Figure 3: Optimum Humidity Range for Human Comfort and Health

The advantage of conditioning the interior space of a building to increase productivity and reduce the downtime of machinery has been documented many times. Unfortunately it is usually equipment, such as computers and communications systems, that is placed in separate climate controlled rooms, while the majority of employees have temperature control only.

Temperature control must be combined with humidity control to maintain proper comfort parameters in an office environment. More than 75% of all I.A.Q. problems start with a comfort complaint. If this is not rectified, the employees will continue to complain and become less productive.

Temperature control alone does not take into account the physiological aspects of the employees. As demonstrated in Figure 3, indoor RH variations above and below the 40-60% range have a dramatic effect on the comfort and well being of employees. Humidity conditions above this range are usually controlled easily by the normal dehumidification process of the air-conditioning system. However, as the cold, dry weather of winter approaches or in arid climates, the indoor RH can easily drop well below the recommended 40% parameter. It is not uncommon

to find relative humidities in the 10-15% range in most offices during this period. This low RH creates comfort, productivity, and absenteeism problems costing immeasurable dollars to employers worldwide. Studies conducted by Dr. George Green of the University of Saskatchewan indicates that increasing the indoor RH from 20 to 30% will reduce absenteeism by 15%. This, along with the productivity increase that can be gained from additional comfort result in a real economic benefit from general office humidification.

Calculating Relative Humidity

If initial temperature and relative humidity are known then Table 2 and Table 3 can be used to calculate the relative humidity after heating, cooling, or adding steam. The following two examples use Table 3 and SI units to show the method used for calculating the RH after heating or after adding steam.

Example 1: RH After Heating - What is the RH if air at 5°C and 80% RH is heated to 30°C?

- 1 Obtain moisture content of air at 5°C and 100% RH from Table 3.

$$A = 0.00680 \text{ kg/cu.m}$$

- 2 Multiply by starting RH to get the actual moisture content of the air.

$$B = 0.00680 \times 80\% / 100\% = 0.00544 \text{ kg/cu.m}$$

- 3 Obtain moisture air at 30°C and 100% RH from Table 3.

$$C = 0.0303 \text{ kg/cu.m}$$

- 4 Divide actual moisture content by moisture content at 100% RH

$$D = B / C = 0.00544 / 0.0303 \times 100\% = 18\%$$

RH After Heating

Example 2: RH after Adding Steam - What is RH if 10 kg of steam is added to 1,000 cu.m of the heated air in example 1?

- 1 Multiply B (the actual moisture content) by the volume to get mass of water in the air.

$$E = B \times 1000 \text{ cu.m} = 0.00544 \text{ kg/cu.m} \times 1000 \text{ cu.m} = 5.44 \text{ kg}$$

- 2 Add the amount of steam being added to the total mass of water.

$$F = E + 10 \text{ kg} = 5.44 \text{ kg} + 10 \text{ kg} = 15.44 \text{ kg}$$

- 3 Divide by the volume of air to kg/cu.m

$$G = F / 1000 \text{ cu.m} = 15.44 \text{ kg} / 1,000 \text{ cu.m} = 0.0154 \text{ kg/cu.m}$$

- 4 Divide by moisture content at 100 % RH

$$H = G / C = 0.0154 / 0.0303 \times 100\% = 51\%$$

RH After Adding steam



Grains/cu.ft – A common unit used for measuring water vapor in air is grains / cubic foot. This document uses pounds/cubic foot and kilograms/cubic meter to simplify calculating humidifier output which is generally expressed in pounds per hour or kilograms per hour.

1 pound water = 7,000 grains.

Table 2: Water Content of Air at 100% RH (IP units)

| °F | lb/cu.ft | °F | lb/cu.ft | °F | lb/cu.ft | °F | lb/cu.ft | °F | lb/cu.ft |
|-----|-----------|----|----------|----|----------|-----|----------|-----|----------|
| -20 | 0.0000343 | 41 | 0.000424 | 61 | 0.000857 | 81 | 0.00163 | 101 | 0.00293 |
| -10 | 0.0000414 | 42 | 0.000440 | 62 | 0.000886 | 82 | 0.00168 | 102 | 0.00302 |
| -5 | 0.0000500 | 43 | 0.000457 | 63 | 0.000916 | 83 | 0.00173 | 103 | 0.00310 |
| 0 | 0.0000686 | 44 | 0.000474 | 64 | 0.000946 | 84 | 0.00178 | 104 | 0.00319 |
| 5 | 0.0000871 | 45 | 0.000491 | 65 | 0.000979 | 85 | 0.00184 | 105 | 0.00328 |
| 10 | 0.000111 | 46 | 0.000509 | 66 | 0.00101 | 86 | 0.00190 | 106 | 0.00337 |
| 15 | 0.000141 | 47 | 0.000527 | 67 | 0.00104 | 87 | 0.00195 | 107 | 0.00347 |
| 20 | 0.000177 | 48 | 0.000547 | 68 | 0.00108 | 88 | 0.00201 | 108 | 0.00356 |
| 25 | 0.000223 | 49 | 0.000567 | 69 | 0.00111 | 89 | 0.00207 | 109 | 0.00366 |
| 30 | 0.000279 | 50 | 0.000587 | 70 | 0.00116 | 90 | 0.00213 | 110 | 0.00376 |
| 31 | 0.000291 | 51 | 0.000609 | 71 | 0.00119 | 91 | 0.00220 | 111 | 0.00387 |
| 32 | 0.000304 | 52 | 0.000630 | 72 | 0.00123 | 92 | 0.00226 | 112 | 0.00397 |
| 33 | 0.000316 | 53 | 0.000651 | 73 | 0.00127 | 93 | 0.00233 | 113 | 0.00408 |
| 34 | 0.000327 | 54 | 0.000674 | 74 | 0.00131 | 94 | 0.00240 | 114 | 0.00419 |
| 35 | 0.000340 | 55 | 0.000699 | 75 | 0.00135 | 95 | 0.00247 | 115 | 0.00430 |
| 36 | 0.000353 | 56 | 0.000723 | 76 | 0.00139 | 96 | 0.00254 | 120 | 0.00491 |
| 37 | 0.000366 | 57 | 0.000747 | 77 | 0.00144 | 97 | 0.00262 | 125 | 0.00559 |
| 38 | 0.000380 | 58 | 0.000773 | 78 | 0.00149 | 98 | 0.00269 | 130 | 0.00634 |
| 39 | 0.000394 | 59 | 0.000800 | 79 | 0.00154 | 99 | 0.00277 | 135 | 0.00719 |
| 40 | 0.000409 | 60 | 0.000829 | 80 | 0.00158 | 100 | 0.00285 | 140 | 0.00812 |

Table 3: Water Content of Air at 100% RH (SI units)

| °C | kg/cu.m | °C | kg/cu.m | °C | kg/cu.m | °C | kg/cu.m | °C | kg/cu.m |
|-----|----------|-----|---------|----|---------|----|---------|----|---------|
| -30 | 0.000578 | -10 | 0.00218 | 10 | 0.00943 | 30 | 0.0303 | 50 | 0.0828 |
| -29 | 0.000553 | -9 | 0.00238 | 11 | 0.0100 | 31 | 0.0320 | 51 | 0.0867 |
| -28 | 0.000540 | -8 | 0.00259 | 12 | 0.0107 | 32 | 0.0337 | 52 | 0.0908 |
| -27 | 0.000540 | -7 | 0.00281 | 13 | 0.0114 | 33 | 0.0356 | 53 | 0.0951 |
| -26 | 0.000551 | -6 | 0.00305 | 14 | 0.0121 | 34 | 0.0375 | 54 | 0.0995 |
| -25 | 0.000573 | -5 | 0.00330 | 15 | 0.0129 | 35 | 0.0395 | 55 | 0.104 |
| -24 | 0.000606 | -4 | 0.00357 | 16 | 0.0137 | 36 | 0.0416 | 56 | 0.109 |
| -23 | 0.000650 | -3 | 0.00385 | 17 | 0.0145 | 37 | 0.0438 | 57 | 0.114 |
| -22 | 0.000704 | -2 | 0.00415 | 18 | 0.0154 | 38 | 0.0461 | 58 | 0.119 |
| -21 | 0.000769 | -1 | 0.00447 | 19 | 0.0163 | 39 | 0.0485 | 59 | 0.124 |
| -20 | 0.000845 | 0 | 0.00481 | 20 | 0.0173 | 40 | 0.0510 | 60 | 0.130 |
| -19 | 0.000931 | 1 | 0.00516 | 21 | 0.0183 | 41 | 0.0536 | 61 | 0.136 |
| -18 | 0.00103 | 2 | 0.00554 | 22 | 0.0194 | 42 | 0.0563 | 62 | 0.142 |
| -17 | 0.00113 | 3 | 0.00594 | 23 | 0.0206 | 43 | 0.0592 | 63 | 0.148 |
| -16 | 0.00125 | 4 | 0.00636 | 24 | 0.0218 | 44 | 0.0621 | 64 | 0.154 |
| -15 | 0.00138 | 5 | 0.00680 | 25 | 0.0230 | 45 | 0.0652 | 65 | 0.161 |
| -14 | 0.00152 | 6 | 0.00727 | 26 | 0.0243 | 46 | 0.0685 | 66 | 0.168 |
| -13 | 0.00167 | 7 | 0.00777 | 27 | 0.0257 | 47 | 0.0718 | 67 | 0.175 |
| -12 | 0.00183 | 8 | 0.00829 | 28 | 0.0272 | 48 | 0.0753 | 68 | 0.182 |
| -11 | 0.00200 | 9 | 0.00884 | 29 | 0.0287 | 49 | 0.0790 | 69 | 0.190 |

Requirements to Calculate Humidification Load

The humidification load calculation assumes that the humidity and temperature in the space being humidified are at the design conditions. Therefore the moisture that must be added is the amount required to bring incoming air to the design condition. Figure 4 shows a schematic of a typical air conditioning system generated by Nortec's HELP software. The figure also shows the 3 factors that must be known to calculate humidification load.

Design Conditions – Temperature and RH that must be maintained in the humidified space.

Outdoor Air Conditions (Incoming Air) – Temperature and RH of the outdoor air.

Incoming Air Volume - The volume of outdoor air that flows into the space being humidified.

H.E.L.P. Software

The easiest way to calculate the humidification load for any application is to use Nortec's Humidifier Engineering and Load-sizing Program (H.E.L.P.). The software can be downloaded from www.humidity.com. The software guides you through the different factors and design considerations affecting humidifier selection and provides an easy means for examining the effect of changing conditions.

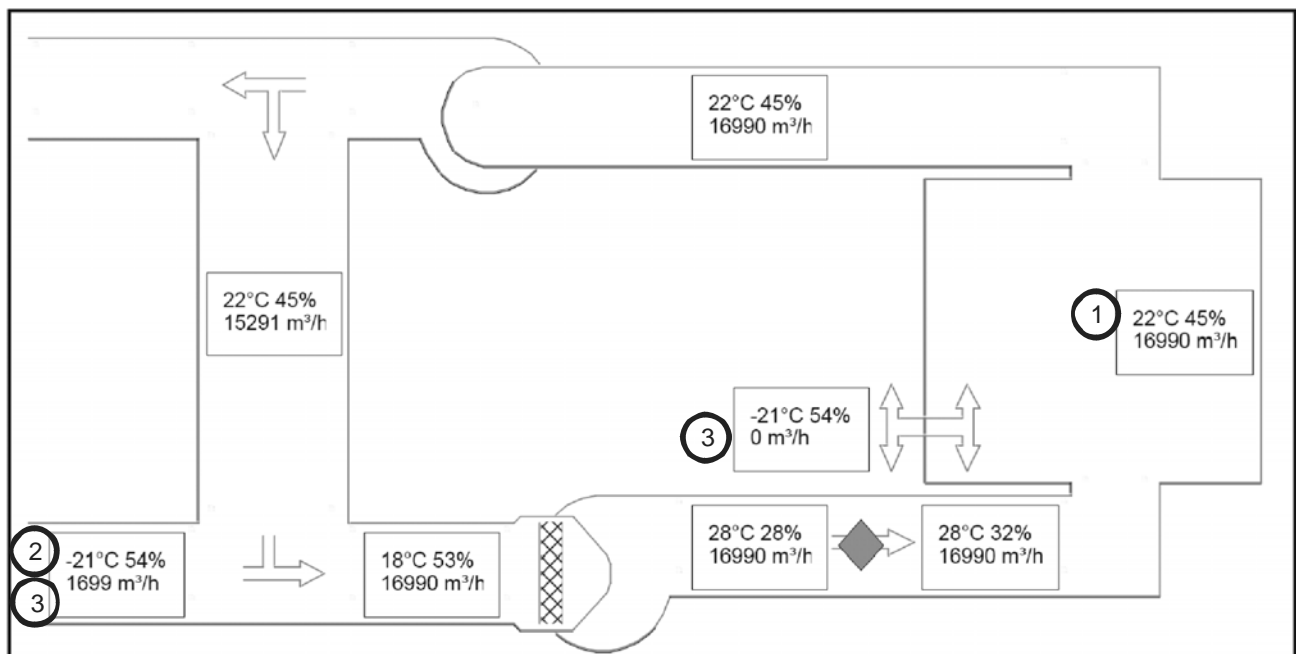


Figure 4: Help Software System Schematic

Design Conditions – Selecting an RH Setpoint

The optimum humidity setpoint depends on the reasons that a space is being humidified. Some of the most common reasons are outlined in Effects of Relative Humidity starting on page 6. The “ASHRAE Handbook – HVAC Applications” recommends specific design relative humidity levels for specific applications. Table 4 provides recommendations for temperature and humidity ranges for various purposes as taken from the ASHRAE Handbook and can be used for the purpose of load calculations.

For More Information on Design Conditions see:

- Nortec Form #00-124A – When You Need Humidity
- The ASHRAE HVAC Applications Handbook.
- Humidifiers section in the ASHRAE HVAC Systems and Equipment Handbook



Table 4: Design Indoor Conditions for Various Places, Products, and Processes

| Product and/or Process | Temperature | | RH % |
|---|-------------|---------|---------|
| | °F | °C | |
| Abrasives Manufacturing | 78 | 25 | 50 |
| Bowling Alleys | 73 – 75 | 23 – 24 | 50 – 55 |
| Billiard Rooms | 73 – 75 | 23 – 24 | 40 – 50 |
| Bread | | | |
| Flour and Powdered Product Storage | 70 – 80 | 21 – 27 | 60 |
| Fermentation (Bread Dough) | 80 | 27 | 75 |
| Retarding of Doughs | 32 – 40 | 0 – 4 | 85 |
| Final Proof | 95 – 120 | 35 – 49 | 85 – 90 |
| Counterflow Cooling | 75 | 24 | 80 – 85 |
| Brewing | | | |
| Brewing Hop Storage Yeast Culture Room | 29 – 32 | 2 – 0 | 50 – 60 |
| Yeast Culture Room | -- | -- | 80 |
| Candy | | | |
| Chocolate Pan Supply Air | 55 – 62 | 13 – 17 | 45 – 55 |
| Enrober Room | 80 – 85 | 27 – 29 | 25 – 30 |
| Chocolate Cooling Tunnel Supply Air | 40 – 45 | 4 – 7 | 70 – 85 |
| Hand Dippers | 62 | 17 | 45 |
| Molded Goods Cooling | 40 – 45 | 4 – 7 | 70 – 85 |
| Chocolate Packing Room and Finished Stock Storage | 65 | 18 | 50 |
| Centers Tempering Room | 75 – 80 | 24 – 27 | 30 – 35 |
| Marshmallow Setting Room | 75 – 78 | 24 – 26 | 40 – 45 |
| Grained Marshmallow (deposited in starch) Drying | 110 | 43 | 40 |
| Gum (deposited in starch) Drying | 125 – 150 | 52 – 66 | 15 – 25 |
| Sanded Gum Drying | 100 | 38 | 25 – 40 |
| Gum Finished Stock Storage | 50 – 65 | 10 – 18 | 65 |
| Sugar Pan Supply Air (engrossing) | 85 – 105 | 29 – 41 | 20 – 30 |
| Polishing Pan Supply Air | 70 – 80 | 21 – 27 | 40 – 50 |
| Pan Rooms | 75 – 80 | 24 – 27 | 30 – 35 |
| Nonpareil Pan Supply Air | 100 – 120 | 38 – 49 | 20 |
| Hard Candy Cooling Tunnel Supply Air | 60 – 70 | 16 – 21 | 40 – 55 |
| Hard Candy Packing | 70 – 75 | 21 – 24 | 35 – 40 |
| Hand Candy Storage | 50 – 70 | 10 – 21 | 40 |
| Caramel Rooms | 70 – 80 | 21 – 27 | 40 |
| Ceramics | | | |
| Refractory | 110 – 150 | 43 – 66 | 50 – 90 |
| Molding Room | 80 | 27 | 60 – 70 |
| Clay Storage | 60 – 80 | 16 – 27 | 35 – 65 |
| Decalcomania Production and Decorating room | 75 – 80 | 24 – 27 | 48 |
| Cereal Packaging | 75 – 80 | 24 – 27 | 45 – 50 |
| Cheese Curing | | | |
| Cheddar | 45 – 55 | 7 – 13 | 85 – 90 |
| Swiss | 60 | 16 | 80 – 85 |
| Blue | 48 – 50 | 9 – 10 | 95 |
| Brick | 60 – 65 | 16 – 18 | 90 |
| Limburger | 60 – 65 | 16 – 18 | 95 |
| Camembert | 53 – 59 | 12 – 15 | 90 |

Table 4: Design Indoor Conditions for Various Places, Products, and Processes (Continued)

| Product and/or Process | Temperature | | RH % |
|---|-------------|-----------|---------|
| | °F | °C | |
| Clean Rooms – Computer Rooms | | | |
| Computer Room | 70 – 80 | 21 – 27 | 40 – 60 |
| Clean Room – General | 70 – 74 | 21 – 23 | 40 – 60 |
| Clean Room – Critical | 71.5 – 72.5 | 22 – 22.5 | 43 – 47 |
| Comfort Air Conditioners | 75 – 80 | 24 – 27 | 50 – 60 |
| Distilling | | | |
| Grain Storage | 60 | 16 | 35 – 40 |
| General Manufacturing | 0 – 75 | 16 – 24 | 45 – 60 |
| Aging | 65 – 72 | 18 – 22 | 50 – 60 |
| Electrical Products | | | |
| Coil and Transformer Winding | 72 | 22 | 15 |
| X-ray Tube Assembly | 68 | 20 | 40 |
| Instruments Manufacture and Laboratory | 70 | 21 | 50 – 55 |
| Thermostat and Humidistat Assembly and Calibration | 76 | 24 | 50 – 55 |
| Close Tolerance Assembly | 72 | 22 | 40 – 45 |
| Meter Assembly and Test | 76 | 24 | 60 – 63 |
| Fuse and Cutout Assembly, Capacitor Winding and Paper Storage | 73 | 23 | 50 |
| Conductor Wrapping with Yarn | 75 | 24 | 65 – 70 |
| Lightning Arrestor Assembly | 68 | 20 | 20 – 40 |
| Thermal Circuit Breaker Assembly | 76 | 24 | 30 – 60 |
| Runner Hopping | 70 | 21 | 30 – 50 |
| Processing Selenium and Copper Oxide Plates | 74 | 23 | 30 – 40 |
| Fruit Storage | | | |
| Apples | 30 – 40 | -1 – 4 | 90 |
| Apricots | 31 – 32 | -1 – 0 | 90 – 95 |
| Grapefruits (California) | 58 – 60 | 14 – 16 | 85 – 90 |
| Grapefruits (Florida) | 50 | 10 | 85 – 90 |
| Grapes (Eastern) | 31 – 32 | -1 – 0 | 85 |
| Grapes (Western) | 30 – 31 | -1 | 90 – 95 |
| Lemons | 58 – 60 | 14 – 16 | 86 – 88 |
| Oranges (California) | 40 – 44 | 4 – 7 | 85 – 90 |
| Oranges (Florida) | 32 – 34 | 0 – 1 | 85 – 90 |
| Peaches and Nectarines | 31 | -1 | 90 |
| Plums | 30 – 32 | -1 – 0 | 90 – 95 |
| Specialty Citrus Fruit | 38 – 40 | 3 – 4 | 90 – 95 |
| Fur Storage | 40 – 50 | 4 – 10 | 55 – 65 |
| Gum | | | |
| Manufacture | 77 | 25 | 33 |
| Rolling | 68 | 20 | 63 |
| Stripping | 72 | 22 | 53 |
| Breaking | 74 | 23 | 47 |
| Wrapping | 74 | 23 | 58 |
| Hospitals | | | |
| Operating, Cystoscopic and Fracture Rooms | 68 – 76 | 20 – 24 | 50 |
| Patient Rooms | 75 | 24 | 40 – 50 |
| Intensive Care Unit | 75 | 24 | 40 |
| Administrative and Service Areas | 70 – 80 | 21 – 27 | 30 – 50 |
| Leather | | | |
| Drying | 70 – 120 | 21 – 49 | 75 |
| Storage, Winter Room Temperature | 50 – 60 | 10 – 16 | 40 – 60 |
| Lenses (Optical) | | | |
| Fusing | 75 | 27 | 45 |
| Grinding | 80 | 27 | 80 |
| Libraries and Museums | | | |
| Normal Reading and Viewing Rooms | 70 – 74 | 21 – 23 | 40 – 50 |
| Rare Manuscript Storage Vaults | 70 – 72 | 21 – 22 | 45 |
| Art Storage Areas | 65 – 72 | 17 – 22 | 50 |

Table 4: Design Indoor Conditions for Various Places, Products, and Processes (Continued)

| Product and/or Process | Temperature | | RH % |
|--|-------------|-----------|--------------------------------|
| | °F | °C | |
| Matches | | | |
| Manufacture | 72 – 74 | 22 – 23 | 50 |
| Drying | 70 – 75 | 21 – 24 | 60 |
| Storage | 60 – 62 | 16 – 17 | 50 |
| Meat and Fish | | | |
| Beef (Fresh) | 32 – 34 | 0 – 1 | 88 – 92 |
| Beef, Fish, Lamb and Pork (Frozen) | -10 – 0 | -23 – -18 | 90 – 95 |
| Fish (Fresh) | 33 – 35 | 1 – 3 | 90 – 95 |
| Lamb and Pork (Fresh) | 32 – 34 | 0 – 1 | 85 – 90 |
| Mushrooms | | | |
| Sweating-out Period | 120 – 140 | 49 – 60 | – |
| Spawn Added | 60 – 75 | 16 – 24 | Nearly Sat. |
| Growing Period | 48 – 60 | 9 – 16 | 80 |
| Storage | 32 – 35 | 0 – 2 | 80 – 85 |
| Oil Paints: Paint Spraying | 60 – 90 | 16 – 32 | 80 |
| Pharmaceuticals | | | |
| Manufactured Powder Storage and Packaging Area | 75 | 24 | 35 |
| Milling Room, Table Compressing and Coating | 75 | 24 | 35 |
| Effervescent Tablets and Powders | 75 | 24 | 20 |
| Hypodermic Tablets | 75 | 24 | 30 |
| Colloids | 70 | 21 | 30 – 50 |
| Cough Drops | 80 | 27 | 40 |
| Glandular Products | 76 | 24 | 5 – 10 |
| Ampoule Manufacturing | 75 | 24 | 35 – 50 |
| Gelatin Capsules and Storage | 76 | 24 | 35 |
| Microanalysis | 76 | 24 | 50 |
| Biological Manufacturing and Liver Extracts | 76 | 24 | 35 |
| Serums | 76 | 24 | 50 |
| Animal Rooms | 75 – 80 | 24 – 27 | 50 |
| Plastics | | | |
| Manufacturing Areas Thermosetting | 80 | 27 | 35 – 30 |
| Molding Compounds | 75 – 80 | 24 – 27 | 45 – 65 |
| Plywood | | | |
| Hot Pressing (Resin) | 90 | 32 | 60 |
| Cold Pressing | 90 | 32 | 15 – 25 |
| Printing | | | |
| Platemaking | 75 – 80 | 24 – 27 | 45 Max |
| Lithographic Press Room | 76 – 80 | 24 – 27 | 43 – 47 |
| Letterpress and Web Offset Press Rooms and Paper Storage | 76 – 80 | 24 – 27 | 50 |
| Paper Storage (Multicolor Sheet Feed Lithography) | 76 – 80 | 24 – 27 | 5 – 8 (higher than press Room) |
| Raw Material Storage | | | |
| Nuts (insect) | 45 | 7 | 65 – 75 |
| Nuts (rancidity) | 34 – 38 | 1 – 3 | 65 – 75 |
| Eggs | 30 | -1 | 85 – 90 |
| Chocolate (flats) | 65 | 18 | 50 |
| Butter | 20 | -7 | |
| Dates, Figs, etc. | 40 – 45 | 4 – 7 | 65 – 75 |
| Corn Syrup | 90 – 100 | 32 – 38 | – |
| Liquid Sugar | 75 – 80 | 24 – 27 | 30 – 40 |
| Rubber Dipped Goods | | | |
| Cementing | 80 | 27 | 25 – 30 |
| Dipping Surgical Articles | 75 – 90 | 24 – 32 | 25 – 30 |
| Storage Prior to Manufacture | 60 – 75 | 16 – 24 | 40 – 50 |
| Laboratory (ASTM Standard) | 73.4 | 23 | 50 |
| Tea Packaging | 65 | 18 | 65 |

Table 4: Design Indoor Conditions for Various Places, Products, and Processes (Continued)

| Product and/or Process | Temperature | | RH % |
|--|-------------|---------|---------|
| | °F | °C | |
| Textiles | | | |
| Opening and Picking Cotton | 75 – 80 | 24 – 27 | 55 – 70 |
| Opening and Picking Man-Made | 70 – 75 | 21 – 24 | 50 – 55 |
| Carding Cotton | 75 – 80 | 24 – 27 | 50 – 55 |
| Carding Wool | 75 – 80 | 24 – 27 | 60 – 70 |
| Carding Man-Made | 70 – 75 | 21 – 24 | 50 – 60 |
| Silver and Ribbon Lapping Cotton | 75 – 80 | 24 – 27 | 55 – 60 |
| Silver and Ribbon Lapping Man-Made | 70 – 75 | 21 – 24 | 55 – 65 |
| Combing Cotton | 75 – 80 | 24 – 27 | 55 – 65 |
| Combing Wool | 75 – 80 | 24 – 27 | 65 – 75 |
| Combing Man-Made | 70 – 75 | 21 – 24 | 55 – 65 |
| Drawing Cotton and Wool | 75 – 80 | 24 – 27 | 50 – 60 |
| Drawing Man-Made | 70 – 75 | 21 – 24 | 50 – 60 |
| Roving Cotton | 75 – 80 | 24 – 27 | 50 – 60 |
| Roving Man-Made | 70 – 75 | 21 – 24 | 50 – 60 |
| Spinning Cotton | 75 – 80 | 24 – 27 | 35 – 60 |
| Spinning Wool | 75 – 80 | 24 – 27 | 50 – 55 |
| Spinning Man-Made | 70 – 75 | 21 – 24 | 50 – 65 |
| Winding and Spooling Cotton | 75 – 80 | 24 – 27 | 55 – 65 |
| Winding and Spooling Wool | 75 – 80 | 24 – 27 | 55 – 60 |
| Winding and Spooling Man-Made | 70 – 75 | 21 – 24 | 60 – 65 |
| Twisting Cotton | 75 – 80 | 24 – 27 | 50 – 65 |
| Twisting Man-Made | 70 – 75 | 21 – 24 | 50 – 65 |
| Warping Cotton | 75 – 80 | 24 – 27 | 55 – 70 |
| Warping Wool | 75 – 80 | 24 – 27 | 50 – 65 |
| Warping Man-Made | 70 – 75 | 21 – 24 | 50 – 65 |
| Knitting Cotton | 76 | 24 | 60 – 65 |
| Knitting Man-Made | 76 | 24 | 50 – 60 |
| Weaving Cotton | 75 – 80 | 24 – 27 | 70 – 85 |
| Weaving Wool | 75 – 80 | 24 – 27 | 50 – 60 |
| Weaving Man-Made | 70 – 75 | 21 – 24 | 60 – 70 |
| Tobacco | | | |
| Cigar and Cigarette Making | 70 – 75 | 21 – 24 | 55 – 65 |
| Softening | 90 | 32 | 85 – 88 |
| Stemming and Stripping | 75 – 85 | 24 – 29 | 70 – 75 |
| Filler Tobacco Casing and Conditioning | 75 | 24 | 75 |
| Filler Tobacco Storage and Preparation | 78 | 26 | 70 |
| Wrapper Tobacco Storage and Conditioning | 75 | 24 | 75 |

Outdoor Air Conditions

The outdoor air conditions vary with geographic location and the time of year. For the purpose of calculating the humidification load the worst case condition is generally used. Table 6: Weather Data – Canada and Table 5: Weather Data - United States provide temperature and RH values for many US and Canadian cities taken from monthly weather data compiled by ASHRAE. The temperature value used is the 99% heating dry bulb temperature for the coldest month of the year. The relative humidity value is the average relative humidity of the driest month of the year.

To obtain the outdoor conditions find the city (or nearest city) where the humidification is required and read the RH and Temp values from the columns with the heading “Load Calculation”. Example; The outdoor air conditions that would be used for a humidification load calculation in the city of Calgary Alberta are 42% RH and -20°F (-29°C).

Table 5: Weather Data - United States

| State | City | Load Calculation | | Economizer Calculation - Temperature F (C) and Relative Humidity in % | | | | | | | | | | | |
|-------|----------------|------------------|------------|---|-----------|-----------|----------|---------|---------|---------|---------|---------|----------|-----------|-----------|
| | | RH | Temp F (C) | J | F | M | A | M | J | J | A | S | O | N | D |
| | | | | | | | | | | | | | | | |
| AL | Birmingham | 51% | 15 (-10) | 15 (-10) | 21 (-6) | 24 (-4) | 40 (4) | 48 (9) | 56 (13) | 62 (17) | 62 (17) | 52 (11) | 41 (5) | 25 (-4) | 20 (-7) |
| | | | | 61% | 55% | 52% | 51% | 55% | 56% | 60% | 59% | 59% | 54% | 57% | 60% |
| | Mobile | 52% | 24 (-5) | 24 (-5) | 29 (-2) | 38 (3) | 47 (8) | 56 (13) | 62 (17) | 69 (20) | 68 (20) | 57 (14) | 46 (8) | 38 (3) | 28 (-2) |
| AK | Anchorage | 49% | -11 (-24) | -11 (-24) | -5 (-21) | -1 (-18) | 14 (-10) | 30 (-1) | 42 (6) | 47 (8) | 42 (6) | 32 (0) | 14 (-10) | -1 (-18) | -8 (-22) |
| | | | | 72% | 67% | 57% | 53% | 49% | 56% | 62% | 64% | 63% | 66% | 73% | 76% |
| | Fairbanks | 38% | -38 (-39) | -38 (-39) | -34 (-37) | -23 (-31) | 0 (-18) | 21 (-6) | 42 (6) | 46 (8) | 39 (4) | 22 (-6) | -2 (-19) | -24 (-31) | -36 (-38) |
| AR | Little Rock | 53% | 15 (-10) | 15 (-10) | 16 (-9) | 29 (-2) | 41 (5) | 52 (11) | 59 (15) | 65 (18) | 63 (17) | 52 (11) | 42 (6) | 31 (0) | 18 (-8) |
| | | | | 61% | 59% | 56% | 56% | 58% | 55% | 56% | 56% | 58% | 53% | 58% | 62% |
| | Bakersfield | 22% | 31 (-1) | 31 (0) | 36 (2) | 40 (5) | 44 (7) | 49 (10) | 57 (14) | 63 (17) | 62 (17) | 56 (13) | 44 (7) | 38 (4) | 31 (-1) |
| CA | | | | 63% | 50% | 43% | 33% | 26% | 23% | 22% | 24% | 28% | 33% | 49% | 61% |
| | Fresno | 22% | 30 (-1) | 30 (-1) | 34 (1) | 37 (3) | 42 (5) | 47 (8) | 54 (12) | 60 (15) | 58 (15) | 50 (10) | 41 (5) | 36 (2) | 30 (-1) |
| | | | | 67% | 55% | 47% | 34% | 26% | 23% | 22% | 25% | 28% | 35% | 53% | 68% |
| | Los Angeles | 59% | 37 (3) | 37 (3) | 43 (6) | 44 (7) | 48 (9) | 52 (11) | 56 (13) | 58 (14) | 60 (15) | 57 (14) | 52 (11) | 45 (7) | 42 (6) |
| | | | | 59% | 63% | 65% | 64% | 66% | 67% | 68% | 69% | 67% | 65% | 67% | 59% |
| | Sacramento | 28% | 30 (-1) | 32 (0) | 34 (1) | 37 (3) | 41 (5) | 45 (7) | 50 (10) | 55 (13) | 56 (13) | 51 (11) | 45 (7) | 37 (3) | 30 (-1) |
| | | | | 70% | 60% | 54% | 43% | 35% | 31% | 28% | 29% | 31% | 38% | 57% | 70% |
| CO | San Diego | 56% | 41 (5) | 41 (5) | 45 (7) | 48 (9) | 50 (10) | 56 (13) | 58 (15) | 62 (17) | 64 (18) | 60 (16) | 54 (12) | 48 (9) | 43 (6) |
| | | | | 56% | 59% | 60% | 59% | 64% | 67% | 66% | 67% | 65% | 64% | 61% | 58% |
| | San Francisco | 58% | 33 (1) | 35 (2) | 37 (3) | 40 (4) | 41 (5) | 45 (7) | 49 (9) | 50 (10) | 51 (10) | 49 (9) | 45 (7) | 38 (3) | 33 (1) |
| CT | | | | 66% | 65% | 63% | 59% | 59% | 58% | 59% | 61% | 59% | 59% | 63% | 67% |
| | Denver | 34% | -3 (-19) | -2 (-19) | -3 (-19) | 9 (-13) | 18 (-8) | 35 (2) | 43 (6) | 53 (12) | 51 (11) | 34 (1) | 22 (-6) | 11 (-12) | -2 (-19) |
| | | | | 49% | 44% | 40% | 35% | 38% | 35% | 34% | 35% | 34% | 35% | 49% | 52% |
| DE | Grand Junction | 19% | -2 (-19) | -2 (-19) | 5 (-15) | 20 (-7) | 27 (-3) | 39 (4) | 48 (9) | 56 (13) | 55 (13) | 43 (6) | 32 (0) | 16 (-9) | 3 (-16) |
| | | | | 64% | 48% | 36% | 28% | 25% | 19% | 22% | 24% | 26% | 33% | 47% | 60% |
| | Pueblo | 28% | -5 (-21) | -5 (-21) | -4 (-20) | 5 (-15) | 21 (-6) | 37 (3) | 48 (9) | 55 (13) | 52 (11) | 41 (5) | 23 (-5) | 6 (-15) | -3 (-19) |
| DC | | | | 51% | 38% | 34% | 30% | 32% | 28% | 32% | 35% | 32% | 33% | 47% | 52% |
| | Bridgeport | 54% | 9 (-13) | 9 (-13) | 11 (-12) | 19 (-7) | 31 (-1) | 43 (6) | 52 (11) | 59 (15) | 57 (14) | 49 (9) | 39 (4) | 29 (-2) | 14 (-10) |
| | | | | 60% | 58% | 56% | 54% | 60% | 61% | 61% | 62% | 62% | 59% | 61% | 61% |
| FL | Wilmington | 50% | 6 (-14) | 6 (-14) | 11 (-11) | 20 (-7) | 32 (0) | 43 (6) | 53 (12) | 60 (15) | 56 (14) | 49 (10) | 37 (3) | 28 (-3) | 12 (-11) |
| | | | | 60% | 57% | 52% | 50% | 53% | 53% | 54% | 57% | 56% | 54% | 56% | 60% |
| | Washington | 49% | 13 (-11) | 13 (-11) | 19 (-7) | 26 (-3) | 37 (3) | 47 (9) | 59 (15) | 65 (18) | 62 (16) | 53 (12) | 42 (5) | 31 (-1) | 18 (-8) |
| GA | | | | 55% | 52% | 50% | 49% | 52% | 52% | 53% | 55% | 56% | 53% | 54% | 57% |
| | Jacksonville | 48% | 26 (-3) | 26 (-3) | 33 (1) | 38 (3) | 46 (8) | 56 (13) | 60 (16) | 68 (20) | 69 (21) | 61 (16) | 50 (10) | 38 (3) | 29 (-2) |
| | | | | 58% | 53% | 50% | 48% | 50% | 57% | 58% | 60% | 62% | 59% | 56% | 58% |
| HI | Miami | 54% | 47 (8) | 47 (8) | 48 (9) | 50 (10) | 59 (15) | 65 (18) | 70 (21) | 75 (24) | 74 (24) | 74 (23) | 64 (18) | 55 (13) | 48 (9) |
| | | | | 59% | 57% | 56% | 54% | 59% | 65% | 63% | 64% | 66% | 63% | 62% | 59% |
| | Atlanta | 49% | 14 (-10) | 14 (-10) | 22 (-6) | 28 (-2) | 40 (5) | 50 (10) | 58 (15) | 63 (17) | 64 (18) | 52 (11) | 42 (6) | 25 (-4) | 20 (-7) |
| ID | | | | 59% | 54% | 51% | 49% | 53% | 55% | 57% | 60% | 59% | 53% | 55% | 58% |
| | Augusta | 45% | 18 (-8) | 18 (-8) | 24 (-5) | 29 (-2) | 39 (4) | 48 (9) | 58 (15) | 64 (18) | 64 (18) | 52 (11) | 38 (3) | 30 (-1) | 22 (-6) |
| | | | | 54% | 49% | 48% | 45% | 49% | 51% | 54% | 57% | 55% | 49% | 50% | 53% |
| IL | Savannah | 46% | 23 (-5) | 23 (-5) | 30 (-1) | 36 (2) | 45 (7) | 53 (12) | 62 (17) | 69 (20) | 67 (19) | 57 (14) | 44 (7) | 34 (1) | 27 (-3) |
| | | | | 55% | 50% | 48% | 46% | 51% | 55% | 57% | 60% | 60% | 53% | 52% | 54% |
| | Honolulu | 51% | 61 (16) | 61 (16) | 61 (16) | 63 (17) | 65 (18) | 67 (20) | 71 (21) | 72 (22) | 73 (23) | 72 (22) | 69 (20) | 66 (19) | 63 (17) |
| IN | | | | 61% | 59% | 57% | 55% | 53% | 52% | 51% | 52% | 52% | 55% | 58% | 60% |
| | Boise | 22% | 1 (-17) | 4 (-15) | 8 (-13) | 21 (-6) | 30 (-1) | 35 (2) | 44 (6) | 48 (9) | 47 (9) | 38 (3) | 27 (-3) | 16 (-9) | 1 (-17) |
| | | | | 70% | 60% | 45% | 36% | 34% | 30% | 22% | 23% | 29% | 39% | 60% | 71% |
| IA | Lewiston | 25% | 5 (-15) | 5 (-15) | 10 (-12) | 20 (-6) | 32 (0) | 37 (3) | 46 (8) | 52 (11) | 52 (11) | 41 (5) | 31 (-1) | 18 (-8) | 5 (-15) |
| | | | | 70% | 61% | 49% | 42% | 39% | 36% | 25% | 25% | 31% | 48% | 68% | 73% |
| | Chicago | 54% | -5 (-21) | -5 (-21) | 2 (-17) | 12 (-11) | 25 (-4) | 38 (3) | 49 (9) | 53 (12) | 53 (12) | 43 (6) | 32 (0) | 18 (-8) | -1 (-18) |
| IL | | | | 67% | 65% | 61% | 55% | 54% | 55% | 57% | 57% | 57% | 56% | 64% | 70% |
| | Peoria | 56% | -4 (-20) | -4 (-20) | 2 (-17) | 12 (-11) | 29 (-1) | 40 (4) | 52 (11) | 58 (15) | 54 (12) | 43 (6) | 33 (1) | 17 (-8) | 0 (-18) |
| | | | | 69% | 67% | 63% | 56% | 56% | 56% | 59% | 60% | 59% | 57% | 67% | 72% |
| IN | Springfield | 54% | -1 (-18) | -1 (-18) | 1 (-17) | 12 (-11) | 33 (0) | 42 (6) | 53 (12) | 59 (15) | 55 (13) | 46 (8) | 33 (0) | 18 (-8) | 2 (-16) |
| | | | | 68% | 68% | 64% | 56% | 54% | 54% | 58% | 60% | 56% | 54% | 65% | 72% |
| | Fort Wayne | 54% | -1 (-19) | -1 (-19) | 2 (-17) | 11 (-11) | 25 (-4) | 40 (4) | 51 (10) | 56 (13) | 51 (11) | 44 (6) | 33 (0) | 18 (-8) | 4 (-16) |
| IA | | | | 71% | 69% | 64% | 57% | 54% | 54% | 56% | 58% | 58% | 58% | 68% | 74% |
| | Indianapolis | 56% | 0 (-18) | 0 (-18) | 2 (-17) | 14 (-10) | 31 (-1) | 42 (5) | 51 (11) | 57 (14) | 54 (12) | 44 (7) | 32 (0) | 18 (-8) | 2 (-17) |
| | | | | 70% | 67% | 62% | 56% | 56% | 56% | 60% | 61% | 58% | 57% | 67% | 72% |
| IA | South bend | 54% | -1 (-18) | -1 (-18) | 3 (-16) | 10 (-12) | 27 (-3) | 38 (4) | 49 (9) | 56 (13) | 53 (11) | 43 (6) | 33 (1) | 15 (-9) | 5 (-15) |
| | | | | 72% | 69% | 62% | 57% | 54% | 55% | 57% | 59% | 60% | 60% | 69% | 76% |
| | Des Moines | 55% | -5 (-20) | -5 (-20) | 0 (-18) | 5 (-15) | 27 (-3) | 43 (6) | 52 (11) | 59 (15) | 54 (12) | 42 (6) | 30 (-1) | 15 (-9) | -1 (-18) |
| IA | | | | 67% | 65% | 61% | 55% | 55% | 56% | 58% | 58% | 59% | 55% | 64% | 69% |
| | Sioux city | 52% | -7 (-22) | -7 (-22) | -4 (-20) | 4 (-16) | 20 (-7) | 40 (4) | 51 (10) | 55 (13) | 52 (11) | 40 (4) | 28 (-2) | 11 (-12) | -4 (-20) |
| | | | | 68% | 67% | 63% | 52% | 54% | 57% | 59% | 61% | 58% | 54% | 64% | 71% |

Table 5: Weather Data - United States (Continued)

| State | City | Load Calculation | | Economizer Calculation - Temperature F (C) and Relative Humidity in % | | | | | | | | | | | |
|-------|------------------|------------------|------------|---|-----------|----------|----------|---------|---------|---------|---------|---------|----------|----------|-----------|
| | | RH | Temp F (C) | J | F | M | A | M | J | J | A | S | O | N | D |
| KS | Dodge City | 44% | 2 (-17) | 5 (-15) | 6 (-15) | 10 (-12) | 30 (-1) | 41 (5) | 53 (12) | 59 (15) | 58 (15) | 45 (7) | 31 (0) | 18 (-8) | 2 (-17) |
| | Topeka | 54% | 0 (-18) | 58% | 56% | 50% | 46% | 51% | 48% | 44% | 47% | 48% | 46% | 53% | 58% |
| | | | | 0 (-18) | 1 (-17) | 15 (-10) | 28 (-2) | 42 (5) | 55 (13) | 57 (14) | 55 (13) | 44 (7) | 33 (1) | 19 (-7) | 0 (-18) |
| KY | Louisville | 52% | 4 (-16) | 64% | 62% | 57% | 55% | 58% | 60% | 59% | 58% | 57% | 54% | 61% | 65% |
| | | | 4 (-16) | 6 (-15) | 20 (-7) | 36 (2) | 45 (7) | 54 (12) | 61 (16) | 58 (14) | 48 (9) | 36 (2) | 20 (-7) | 9 (-13) | |
| | | | 64% | 61% | 57% | 52% | 55% | 56% | 58% | 58% | 59% | 55% | 61% | 65% | |
| LA | New Orleans | 59% | 30 (-1) | 30 (-1) | 34 (1) | 40 (5) | 47 (8) | 55 (13) | 62 (17) | 69 (20) | 68 (20) | 58 (14) | 49 (9) | 40 (4) | 30 (-1) |
| | Shreveport | 54% | 21 (-6) | 66% | 63% | 60% | 59% | 60% | 63% | 66% | 66% | 65% | 59% | 61% | 66% |
| | | | | 21 (-6) | 27 (-3) | 35 (2) | 45 (7) | 54 (12) | 63 (17) | 67 (20) | 64 (18) | 56 (13) | 43 (6) | 33 (0) | 23 (-5) |
| ME | Portland | 55% | -11 (-24) | 63% | 59% | 56% | 57% | 59% | 58% | 57% | 55% | 57% | 54% | 58% | 62% |
| | | | -5 (-21) | -11 (-24) | 4 (-16) | 23 (-5) | 35 (2) | 45 (7) | 51 (11) | 47 (8) | 38 (3) | 29 (-2) | 19 (-7) | 0 (-18) | |
| | | | 60% | 58% | 57% | 55% | 58% | 60% | 59% | 59% | 60% | 59% | 62% | 61% | |
| MD | Baltimore | 49% | 10 (-12) | 10 (-12) | 13 (-10) | 22 (-6) | 33 (1) | 44 (7) | 53 (12) | 60 (16) | 57 (14) | 49 (9) | 37 (3) | 27 (-3) | 16 (-9) |
| | | | 57% | 54% | 51% | 49% | 52% | 52% | 53% | 55% | 55% | 54% | 55% | 58% | |
| | | | 7 (-14) | 12 (-11) | 21 (-6) | 30 (-1) | 44 (7) | 54 (12) | 60 (15) | 58 (14) | 49 (10) | 39 (4) | 29 (-2) | 12 (-11) | |
| MA | Boston | 55% | 7 (-14) | 57% | 56% | 57% | 55% | 59% | 58% | 57% | 59% | 60% | 58% | 59% | 59% |
| | | | -1 (-18) | 3 (-16) | 14 (-10) | 25 (-4) | 38 (3) | 48 (9) | 53 (12) | 51 (10) | 43 (6) | 31 (-1) | 23 (-5) | 8 (-14) | |
| | | | 69% | 65% | 61% | 55% | 53% | 54% | 54% | 56% | 57% | 57% | 65% | 71% | |
| MI | Detroit | 53% | -1 (-18) | -1 (-18) | 0 (-18) | 11 (-12) | 21 (-6) | 36 (2) | 46 (8) | 53 (12) | 51 (10) | 40 (5) | 31 (-1) | 20 (-7) | 3 (-16) |
| | Grand Rapids | 53% | -1 (-18) | 72% | 68% | 64% | 57% | 53% | 55% | 56% | 58% | 61% | 62% | 70% | 75% |
| | | | | -19 (-28) | -13 (-25) | -5 (-20) | 14 (-10) | 30 (-1) | 40 (4) | 47 (8) | 45 (7) | 35 (2) | 24 (-5) | 1 (-17) | -13 (-25) |
| MN | Duluth | 53% | -19 (-28) | 70% | 65% | 63% | 56% | 53% | 60% | 59% | 63% | 64% | 62% | 70% | 74% |
| | Minneapolis-St.P | 52% | -14 (-25) | -14 (-25) | -7 (-22) | -3 (-19) | 21 (-6) | 35 (2) | 48 (9) | 55 (13) | 52 (11) | 40 (5) | 29 (-2) | 6 (-14) | -7 (-22) |
| | | | | 67% | 65% | 61% | 52% | 52% | 54% | 54% | 57% | 59% | 58% | 66% | 70% |
| MS | Jackson | 53% | 19 (-7) | 19 (-7) | 25 (-4) | 32 (0) | 41 (5) | 51 (11) | 59 (15) | 63 (17) | 64 (18) | 51 (11) | 40 (5) | 32 (0) | 22 (-6) |
| | | | 65% | 60% | 56% | 54% | 56% | 56% | 59% | 58% | 58% | 53% | 57% | 63% | |
| | | | 2 (-17) | 3 (-16) | 13 (-10) | 30 (-1) | 44 (7) | 55 (13) | 62 (17) | 56 (14) | 47 (8) | 33 (1) | 19 (-7) | 1 (-17) | |
| MO | Kansas City | 55% | 1 (-17) | 64% | 64% | 59% | 56% | 59% | 59% | 58% | 59% | 59% | 55% | 62% | 65% |
| | St. Louis | 54% | 3 (-16) | 3 (-16) | 10 (-12) | 17 (-8) | 36 (2) | 46 (8) | 56 (14) | 63 (17) | 59 (15) | 50 (10) | 38 (3) | 21 (-6) | 7 (-14) |
| | | | | 66% | 63% | 59% | 54% | 55% | 55% | 56% | 58% | 55% | 63% | 68% | |
| MT | Billings | 30% | -7 (-22) | -6 (-21) | -7 (-22) | 5 (-15) | 17 (-9) | 31 (-1) | 44 (7) | 52 (11) | 48 (9) | 36 (2) | 17 (-8) | 4 (-16) | -6 (-21) |
| | Great Falls | 31% | -12 (-25) | -11 (-24) | -7 (-22) | -1 (-18) | 15 (-9) | 30 (-1) | 42 (5) | 49 (9) | 43 (6) | 34 (1) | 14 (-10) | 2 (-17) | -12 (-25) |
| | | | | 60% | 54% | 49% | 41% | 41% | 40% | 31% | 31% | 38% | 43% | 55% | 60% |
| NE | North Platte | 46% | -9 (-23) | -5 (-21) | -2 (-19) | 3 (-16) | 22 (-5) | 34 (1) | 44 (6) | 52 (11) | 48 (9) | 34 (1) | 24 (-5) | 6 (-14) | -9 (-23) |
| | Omaha | 52% | -4 (-20) | 63% | 59% | 53% | 47% | 51% | 52% | 50% | 51% | 48% | 46% | 55% | 61% |
| | | | | -4 (-20) | 0 (-18) | 8 (-13) | 24 (-4) | 41 (5) | 51 (11) | 57 (14) | 55 (13) | 41 (5) | 29 (-2) | 12 (-11) | -2 (-19) |
| NV | Las Vegas | 11% | 23 (-5) | 65% | 63% | 57% | 52% | 54% | 55% | 58% | 59% | 59% | 55% | 62% | 67% |
| | Reno | 18% | 4 (-16) | 23 (-5) | 29 (-1) | 35 (2) | 43 (6) | 52 (11) | 61 (16) | 70 (21) | 67 (20) | 58 (15) | 42 (6) | 34 (1) | 24 (-4) |
| | | | | 31% | 27% | 22% | 16% | 14% | 11% | 15% | 17% | 19% | 19% | 26% | 32% |
| NH | Concord | 47% | -11 (-24) | 4 (-15) | 6 (-14) | 16 (-9) | 25 (-4) | 31 (-1) | 38 (3) | 44 (7) | 39 (4) | 33 (0) | 22 (-5) | 16 (-9) | 4 (-16) |
| | | | 51% | 40% | 33% | 27% | 25% | 22% | 18% | 19% | 21% | 27% | 41% | 51% | |
| | | | -11 (-24) | -11 (-24) | 5 (-15) | 22 (-6) | 33 (1) | 43 (6) | 48 (9) | 44 (7) | 36 (2) | 24 (-4) | 13 (-11) | -2 (-19) | |
| NJ | Atlantic City | 52% | 8 (-14) | 58% | 55% | 52% | 47% | 47% | 52% | 51% | 53% | 55% | 53% | 59% | 61% |
| | Newark | 48% | 10 (-12) | 8 (-14) | 8 (-13) | 20 (-7) | 28 (-2) | 39 (4) | 50 (10) | 55 (13) | 54 (12) | 46 (8) | 34 (1) | 25 (-4) | 12 (-11) |
| | | | | 58% | 56% | 54% | 52% | 56% | 56% | 57% | 58% | 58% | 56% | 58% | 58% |
| NM | Albuquerque | 18% | 4 (-15) | 10 (-12) | 11 (-12) | 22 (-6) | 31 (0) | 45 (7) | 55 (13) | 62 (17) | 58 (15) | 49 (10) | 40 (5) | 29 (-2) | 16 (-9) |
| | | | 58% | 54% | 51% | 48% | 51% | 51% | 53% | 55% | 53% | 56% | 59% | | |
| | | | 4 (-15) | 13 (-11) | 22 (-6) | 31 (0) | 40 (5) | 51 (11) | 60 (16) | 58 (15) | 48 (9) | 34 (1) | 14 (-10) | 10 (-12) | |
| NY | Albany | 49% | -7 (-21) | 41% | 33% | 25% | 19% | 19% | 18% | 27% | 31% | 30% | 29% | 36% | 44% |
| | Buffalo | 55% | 1 (-17) | -7 (-21) | -2 (-19) | 4 (-16) | 25 (-4) | 38 (3) | 47 (9) | 52 (11) | 48 (9) | 39 (4) | 29 (-2) | 20 (-7) | 0 (-18) |
| | | | | 63% | 58% | 53% | 49% | 52% | 56% | 55% | 58% | 59% | 57% | 62% | 65% |
| NC | New York | 55% | 13 (-10) | 3 (-16) | 1 (-17) | 11 (-11) | 26 (-3) | 39 (4) | 48 (9) | 54 (12) | 51 (11) | 45 (7) | 33 (1) | 23 (-5) | 8 (-13) |
| | Rochester | 54% | 1 (-17) | 72% | 70% | 65% | 58% | 55% | 56% | 55% | 58% | 60% | 60% | 69% | 73% |
| | | | | 13 (-10) | 14 (-10) | 23 (-5) | 33 (1) | 45 (7) | 55 (13) | 64 (18) | 59 (15) | 52 (11) | 39 (4) | 32 (0) | 18 (-8) |
| ND | Syracuse | 53% | -4 (-20) | 59% | 57% | 56% | 55% | 59% | 60% | 59% | 60% | 60% | 56% | 59% | 60% |
| | | | 2 (-17) | 1 (-17) | 12 (-11) | 26 (-3) | 38 (3) | 47 (8) | 53 (12) | 49 (9) | 42 (5) | 33 (0) | 21 (-6) | 5 (-15) | |
| | | | 69% | 67% | 62% | 56% | 54% | 55% | 54% | 58% | 61% | 61% | 68% | 72% | |
| NC | Asheville | 50% | 6 (-14) | -4 (-20) | -3 (-20) | 7 (-14) | 24 (-4) | 38 (3) | 46 (8) | 54 (12) | 51 (10) | 42 (5) | 32 (0) | 21 (-6) | 2 (-17) |
| | Raleigh | 45% | 12 (-11) | 68% | 65% | 60% | 53% | 55% | 56% | 56% | 59% | 62% | 61% | 67% | 71% |
| | | | | 6 (-14) | 15 (-10) | 21 (-6) | 34 (1) | 41 (5) | 49 (9) | 55 (13) | 54 (12) | 45 (7) | 34 (1) | 24 (-5) | 13 (-11) |
| ND | Bismarck | 46% | -21 (-29) | 59% | 55% | 53% | 50% | 57% | 59% | 62% | 63% | 63% | 56% | 57% | 59% |
| | | | 12 (-11) | 20 (-7) | 27 (-3) | 37 (3) | 45 (7) | 53 (12) | 60 (16) | 59 (15) | 51 (11) | 36 (2) | 27 (-3) | 20 (-7) | |
| | | | 55% | 52% | 49% | 45% | 54% | 56% | 58% | 60% | 58% | 53% | 52% | 55% | |
| ND | Bismarck | 46% | -21 (-29) | -21 (-29) | -15 (-26) | -5 (-20) | 12 (-11) | 31 (-1) | 43 (6) | 48 (9) | 45 (7) | 29 (-2) | 13 (-10) | -4 (-20) | -18 (-28) |
| | | | 68% | 68% | 62% | 51% | 48% | 52% | 47% | 46% | 50% | 51% | 65% | 71% | |
| | | | | | | | | | | | | | | | |

Table 5: Weather Data - United States (Continued)

| State | City | Load Calculation | | Economizer Calculation - Temperature F (C) and Relative Humidity in % | | | | | | | | | | | |
|-------|--------------------|------------------|------------|---|-----------------|-----------------|-----------------|----------------|----------------|----------------|----------------|----------------|----------------|-----------------|-----------------|
| | | RH | Temp F (C) | J | F | M | A | M | J | J | A | S | O | N | D |
| OH | Cleveland | 57% | 1 (-17) | 1 (-17) 69% | 4 (-15) 68% | 14 (-10) 63% | 26 (-4) 57% | 38 (3) 57% | 46 (8) 57% | 53 (12) 57% | 51 (11) 60% | 45 (7) 60% | 33 (1) 59% | 21 (-6) 65% | 7 (-14) 70% |
| | Columbus | 53% | 2 (-17) | 2 (-17) 67% | 6 (-14) 64% | 15 (-10) 57% | 29 (-2) 53% | 40 (4) 55% | 49 (9) 55% | 55 (13) 56% | 52 (11) 58% | 45 (7) 57% | 33 (1) 55% | 22 (-6) 63% | 6 (-15) 69% |
| | Greater Cincinnati | 54% | -1 (-18) | -1 (-18) 68% | 8 (-13) 64% | 13 (-11) 59% | 32 (0) 54% | 41 (5) 55% | 52 (11) 56% | 58 (14) 57% | 55 (13) 58% | 46 (8) 58% | 32 (0) 55% | 20 (-7) 63% | 5 (-15) 69% |
| | Toledo | 52% | -1 (-18) | -1 (-18) 70% | 4 (-16) 66% | 12 (-11) 61% | 24 (-4) 55% | 38 (3) 52% | 46 (8) 54% | 52 (11) 55% | 48 (9) 58% | 41 (5) 58% | 30 (-1) 57% | 19 (-7) 66% | 3 (-16) 73% |
| OK | Oklahoma City | 50% | 12 (-11) | 13 (-11) 60% | 15 (-9) 58% | 23 (-5) 53% | 36 (2) 52% | 49 (10) 58% | 59 (15) 56% | 64 (18) 50% | 62 (17) 50% | 51 (11) 55% | 35 (2) 52% | 27 (-3) 56% | 12 (-11) 58% |
| OR | Portland | 45% | 18 (-8) | 18 (-8) 75% | 19 (-7) 67% | 31 (-1) 60% | 37 (3) 55% | 40 (4) 53% | 48 (9) 49% | 52 (11) 45% | 52 (11) 46% | 45 (7) 48% | 37 (3) 47% | 28 (-2) 74% | 22 (-5) 78% |
| PA | Harrisburg | 49% | 8 (-13) | 8 (-13) 58% | 11 (-12) 55% | 21 (-6) 52% | 32 (0) 49% | 43 (6) 52% | 52 (11) 53% | 59 (15) 52% | 57 (14) 55% | 45 (7) 56% | 36 (2) 54% | 27 (-3) 57% | 11 (-12) 58% |
| | Philadelphia | 49% | 10 (-12) | 10 (-12) 59% | 12 (-11) 55% | 22 (-6) 52% | 33 (0) 50% | 42 (6) 52% | 55 (13) 54% | 61 (16) 55% | 57 (14) 55% | 49 (9) 56% | 38 (3) 54% | 28 (-2) 62% | 17 (-9) 67% |
| | Pittsburgh | 50% | 2 (-17) | 2 (-17) 65% | 6 (-14) 62% | 16 (-9) 57% | 28 (-2) 50% | 39 (4) 52% | 47 (9) 52% | 54 (12) 54% | 52 (11) 56% | 44 (7) 57% | 31 (0) 54% | 19 (-7) 62% | 8 (-13) 67% |
| | Williamsport | 49% | 2 (-17) | 2 (-17) 62% | 5 (-15) 58% | 16 (-9) 54% | 29 (-2) 46% | 40 (4) 51% | 48 (9) 54% | 54 (12) 55% | 51 (11) 58% | 43 (6) 59% | 33 (0) 57% | 23 (-5) 61% | 6 (-14) 63% |
| RI | Providence | 49% | 5 (-15) | 5 (-15) 56% | 9 (-13) 54% | 17 (-8) 53% | 28 (-2) 49% | 40 (5) 52% | 51 (11) 56% | 58 (14) 56% | 53 (12) 56% | 45 (7) 56% | 34 (1) 54% | 22 (-5) 57% | 9 (-13) 58% |
| SC | Charleston | 49% | 24 (-5) | 24 (-5) 56% | 28 (-2) 52% | 33 (1) 51% | 43 (6) 49% | 51 (11) 53% | 62 (16) 58% | 67 (20) 62% | 66 (19) 63% | 57 (14) 62% | 44 (6) 55% | 33 (1) 53% | 26 (-3) 55% |
| | Columbia | 43% | 18 (-8) | 18 (-8) 54% | 22 (-6) 49% | 25 (-4) 48% | 40 (4) 43% | 48 (9) 49% | 57 (14) 51% | 64 (18) 54% | 63 (17) 57% | 54 (12) 56% | 39 (4) 51% | 29 (-2) 51% | 21 (-6) 53% |
| SD | Rapid City | 37% | -7 (-21) | -6 (-21) 63% | -2 (-19) 61% | 5 (-15) 54% | 19 (-7) 46% | 32 (0) 47% | 43 (6) 48% | 51 (10) 41% | 49 (9) 37% | 34 (1) 38% | 18 (-8) 45% | 4 (-16) 59% | -7 (-21) 64% |
| | Sioux Falls | 53% | -14 (-26) | -14 (-26) 68% | -9 (-23) 68% | 2 (-17) 64% | 22 (-6) 54% | 33 (1) 53% | 47 (8) 55% | 52 (11) 54% | 49 (9) 55% | 37 (3) 57% | 25 (-4) 55% | 5 (-15) 66% | -8 (-22) 71% |
| TN | Knoxville | 51% | 3 (-16) | 3 (-16) 63% | 16 (-9) 59% | 21 (-6) 55% | 35 (2) 51% | 45 (7) 57% | 54 (12) 59% | 60 (15) 61% | 59 (15) 61% | 50 (10) 60% | 38 (3) 55% | 23 (-5) 55% | 14 (-10) 64% |
| | Memphis | 51% | 13 (-11) | 15 (-9) 63% | 14 (-10) 60% | 30 (-1) 56% | 43 (6) 53% | 52 (11) 55% | 60 (16) 56% | 64 (18) 57% | 62 (16) 57% | 52 (11) 56% | 40 (5) 51% | 28 (-2) 56% | 13 (-11) 61% |
| | Nashville | 51% | 7 (-14) | 7 (-14) 63% | 10 (-12) 59% | 23 (-5) 53% | 37 (3) 51% | 47 (9) 56% | 55 (13) 55% | 62 (17) 57% | 59 (15) 57% | 51 (10) 58% | 39 (4) 53% | 21 (-6) 59% | 12 (-11) 63% |
| | Nashville | 51% | 7 (-14) | 7 (-14) 63% | 10 (-12) 59% | 23 (-5) 53% | 37 (3) 51% | 47 (9) 56% | 55 (13) 55% | 62 (17) 57% | 59 (15) 57% | 51 (10) 58% | 39 (4) 53% | 21 (-6) 59% | 12 (-11) 63% |
| TX | Amarillo | 38% | 7 (-14) | 7 (-14) 51% | 8 (-13) 50% | 17 (-8) 42% | 30 (-1) 38% | 42 (5) 43% | 53 (12) 45% | 60 (16) 42% | 58 (15) 47% | 45 (7) 49% | 30 (-1) 43% | 18 (-8) 47% | 10 (-12) 49% |
| | Corpus Christi | 57% | 32 (0) | 32 (0) 69% | 35 (2) 65% | 42 (5) 61% | 50 (10) 58% | 60 (16) 66% | 68 (20) 63% | 71 (22) 57% | 72 (22) 58% | 63 (17) 61% | 48 (9) 59% | 44 (7) 61% | 33 (0) 64% |
| | Dallas-Fort Worth | 49% | 20 (-7) | 20 (-6) 60% | 24 (-4) 58% | 32 (0) 56% | 44 (7) 56% | 54 (12) 60% | 63 (17) 55% | 69 (20) 49% | 67 (19) 49% | 57 (14) 55% | 44 (7) 54% | 35 (1) 57% | 20 (-7) 59% |
| | El Paso | 16% | 13 (-11) | 13 (-11) 35% | 23 (-5) 27% | 29 (-2) 21% | 38 (3) 16% | 46 (8) 17% | 57 (14) 18% | 65 (18) 30% | 63 (17) 33% | 53 (12) 34% | 39 (4) 30% | 22 (-6) 30% | 20 (-7) 38% |
| | Houston | 56% | 27 (-3) | 28 (-2) 64% | 33 (1) 61% | 38 (3) 59% | 47 (8) 58% | 56 (13) 60% | 63 (17) 60% | 69 (21) 57% | 68 (20) 57% | 60 (16) 60% | 45 (7) 56% | 36 (2) 60% | 27 (-3) 62% |
| | San Antonio | 51% | 21 (-6) | 21 (-6) 59% | 26 (-4) 57% | 36 (2) 53% | 47 (8) 56% | 56 (14) 59% | 65 (18) 56% | 71 (21) 52% | 70 (21) 51% | 57 (14) 54% | 45 (7) 53% | 37 (3) 55% | 25 (-4) 57% |
| UT | Salt Lake City | 22% | -1 (-18) | 1 (-17) 70% | -1 (-18) 60% | 19 (-7) 47% | 28 (-2) 39% | 37 (3) 33% | 47 (8) 26% | 54 (12) 22% | 51 (11) 23% | 41 (5) 29% | 30 (-1) 41% | 10 (-12) 59% | 2 (-17) 71% |
| VT | Burlington | 51% | -9 (-23) | -9 (-23) 64% | -9 (-23) 62% | 3 (-16) 58% | 20 (-7) 53% | 37 (3) 51% | 46 (8) 55% | 51 (11) 53% | 48 (9) 57% | 39 (4) 61% | 29 (-2) 61% | 16 (-9) 66% | -3 (-20) 68% |
| VA | Richmond | 46% | 9 (-13) | 9 (-13) 57% | 11 (-12) 53% | 26 (-4) 49% | 36 (2) 46% | 45 (7) 51% | 53 (12) 53% | 61 (16) 56% | 58 (15) 57% | 49 (9) 56% | 36 (2) 53% | 26 (-3) 51% | 16 (-9) 55% |
| WA | Seattle | 49% | 20 (-7) | 20 (-7) 74% | 21 (-6) 67% | 27 (-3) 62% | 37 (3) 58% | 39 (4) 54% | 47 (8) 53% | 51 (11) 49% | 52 (11) 50% | 45 (7) 56% | 39 (4) 67% | 25 (-4) 75% | 23 (-5) 78% |
| | Spokane | 28% | 0 (-18) | 1 (-17) 79% | 6 (-14) 69% | 13 (-10) 55% | 28 (-2) 44% | 35 (2) 41% | 43 (6) 36% | 48 (9) 28% | 47 (8) 28% | 37 (3) 34% | 25 (-4) 48% | 6 (-15) 76% | 0 (-18) 83% |
| WV | Charleston | 47% | 6 (-14) | 6 (-14) 63% | 12 (-11) 59% | 20 (-7) 53% | 33 (0) 47% | 41 (5) 51% | 48 (9) 54% | 57 (14) 59% | 54 (12) 58% | 47 (8) 56% | 33 (0) 54% | 23 (-5) 56% | 10 (-12) 62% |
| WI | Green Bay | 54% | -11 (-24) | -11 (-24) 70% | -6 (-21) 68% | -2 (-19) 65% | 22 (-5) 58% | 34 (1) 54% | 45 (7) 57% | 51 (11) 58% | 49 (10) 61% | 38 (4) 62% | 29 (-2) 62% | 11 (-12) 69% | -5 (-21) 73% |
| | Milwaukee | 60% | -5 (-21) | -5 (-21) 68% | 0 (-18) 67% | 10 (-12) 65% | 26 (-3) 61% | 35 (2) 60% | 46 (8) 60% | 53 (12) 61% | 54 (12) 62% | 42 (6) 63% | 32 (0) 62% | 15 (-10) 67% | 1 (-17) 71% |
| WY | Cheyenne | 38% | -6 (-21) | -5 (-21) 50% | -6 (-21) 48% | 3 (-16) 47% | 13 (-11) 42% | 30 (-1) 44% | 39 (4) 41% | 48 (9) 38% | 46 (8) 38% | 28 (-2) 38% | 18 (-8) 41% | 6 (-15) 51% | -4 (-20) 53% |

Table 6: Weather Data – Canada

| Prov | City | Load Calculation | | Economizer Calculation - Temperature F (C) and Relative Humidity in % | | | | | | | | | | | |
|------|-----------------|------------------|------------|---|-----------|-----------|-----------|----------|---------|---------|---------|---------|----------|-----------|-----------|
| | | RH | Temp F (C) | J | F | M | A | M | J | J | A | S | O | N | D |
| AB | Calgary | 42% | -20 (-29) | -20 (-29) | -18 (-28) | -7 (-22) | 5 (-15) | 22 (-6) | 38 (3) | 42 (6) | 40 (4) | 25 (-4) | 10 (-12) | -6 (-21) | -17 (-27) |
| | | | | 59% | 57% | 55% | 43% | 42% | 44% | 44% | 43% | 45% | 43% | 56% | 60% |
| | Edmonton | 40% | -23 (-30) | -21 (-30) | -20 (-29) | -6 (-21) | 10 (-12) | 28 (-2) | 42 (6) | 45 (7) | 44 (7) | 29 (-2) | 12 (-11) | -4 (-20) | -23 (-30) |
| BC | Red Deer | 43% | -25 (-32) | -25 (-32) | -20 (-29) | -14 (-26) | 2 (-17) | 22 (-5) | 36 (2) | 42 (6) | 39 (4) | 26 (-3) | 8 (-13) | -11 (-24) | -22 (-30) |
| | | | | 68% | 67% | 63% | 47% | 43% | 48% | 51% | 51% | 51% | 47% | 64% | 69% |
| | Kelowna | 37% | -5 (-20) | -2 (-19) | 6 (-15) | 14 (-10) | 26 (-3) | 35 (2) | 41 (5) | 45 (7) | 43 (6) | 33 (1) | 20 (-6) | 6 (-15) | -5 (-20) |
| BC | Prince George | 42% | -24 (-31) | -24 (-31) | -16 (-27) | -5 (-21) | 10 (-12) | 29 (-2) | 37 (3) | 40 (4) | 37 (3) | 26 (-3) | 10 (-12) | -10 (-23) | -18 (-28) |
| | | | | 75% | 68% | 55% | 42% | 43% | 46% | 47% | 49% | 55% | 61% | 76% | 79% |
| | Prince Rupert | 69% | 10 (-12) | 10 (-12) | 17 (-8) | 19 (-7) | 29 (-2) | 37 (3) | 42 (5) | 45 (7) | 46 (8) | 39 (4) | 28 (-2) | 16 (-9) | 12 (-11) |
| MB | Victoria | 58% | 20 (-7) | 20 (-7) | 22 (-6) | 27 (-3) | 34 (1) | 39 (4) | 44 (7) | 47 (9) | 48 (9) | 41 (5) | 35 (2) | 24 (-4) | 22 (-6) |
| | | | | 80% | 73% | 67% | 62% | 61% | 60% | 58% | 59% | 62% | 71% | 78% | 82% |
| | The Pas | 49% | -32 (-35) | -30 (-35) | -32 (-35) | -16 (-27) | 2 (-17) | 25 (-4) | 39 (4) | 46 (8) | 44 (7) | 32 (0) | 19 (-7) | -8 (-22) | -26 (-32) |
| NB | Winnipeg | 45% | -25 (-32) | -25 (-32) | -25 (-32) | -11 (-24) | 8 (-13) | 28 (-2) | 40 (5) | 47 (8) | 45 (7) | 33 (1) | 19 (-7) | -5 (-20) | -17 (-27) |
| | | | | 75% | 75% | 72% | 54% | 45% | 50% | 52% | 50% | 53% | 56% | 72% | 77% |
| | Fredericton | 51% | -13 (-25) | -12 (-24) | -13 (-25) | 1 (-17) | 20 (-7) | 32 (0) | 42 (6) | 47 (8) | 46 (8) | 36 (2) | 27 (-3) | 14 (-10) | -7 (-22) |
| NL | Moncton | 57% | -7 (-22) | -7 (-22) | -7 (-21) | 2 (-17) | 18 (-8) | 32 (0) | 40 (4) | 47 (8) | 45 (7) | 37 (3) | 27 (-3) | 16 (-9) | -2 (-19) |
| | | | | 70% | 67% | 65% | 62% | 57% | 58% | 59% | 60% | 61% | 63% | 71% | 74% |
| | St John | 61% | -11 (-24) | -7 (-22) | -11 (-24) | 0 (-18) | 18 (-8) | 30 (-1) | 40 (4) | 45 (7) | 44 (7) | 35 (2) | 27 (-3) | 17 (-8) | -6 (-21) |
| NT | Churchill Falls | 57% | -31 (-35) | -30 (-34) | -31 (-35) | -18 (-28) | -3 (-19) | 12 (-11) | 33 (0) | 42 (6) | 40 (4) | 30 (-1) | 13 (-11) | -5 (-21) | -24 (-31) |
| | | | | 76% | 73% | 71% | 68% | 60% | 57% | 58% | 60% | 67% | 75% | 80% | 78% |
| | Gander | 61% | -5 (-20) | 0 (-18) | -5 (-20) | 1 (-17) | 17 (-8) | 27 (-3) | 37 (3) | 44 (7) | 43 (6) | 38 (4) | 29 (-1) | 20 (-7) | 4 (-16) |
| NS | St Johns | 69% | 5 (-15) | 6 (-14) | 5 (-15) | 7 (-14) | 19 (-7) | 29 (-2) | 36 (2) | 42 (6) | 44 (7) | 40 (4) | 32 (0) | 23 (-5) | 12 (-11) |
| | | | | 80% | 78% | 77% | 76% | 73% | 70% | 69% | 71% | 72% | 76% | 80% | 81% |
| | Yellowknife | 45% | -41 (-41) | -41 (-41) | -39 (-39) | -27 (-33) | -13 (-25) | 13 (-10) | 37 (3) | 45 (7) | 42 (6) | 28 (-2) | 4 (-15) | -23 (-31) | -35 (-37) |
| ON | Halifax | 62% | 1 (-17) | 2 (-17) | 1 (-17) | 8 (-13) | 25 (-4) | 34 (1) | 43 (6) | 51 (11) | 50 (10) | 41 (5) | 32 (0) | 22 (-6) | 7 (-14) |
| | | | | 76% | 73% | 69% | 65% | 62% | 63% | 64% | 64% | 64% | 67% | 75% | 77% |
| | Sydney | 66% | 1 (-17) | 3 (-16) | 1 (-17) | 6 (-14) | 20 (-7) | 29 (-2) | 37 (3) | 47 (8) | 48 (9) | 40 (4) | 33 (0) | 23 (-5) | 12 (-11) |
| ON | | | | 76% | 73% | 74% | 73% | 68% | 67% | 67% | 66% | 69% | 71% | 77% | 78% |
| | Hamilton | 57% | 0 (-18) | 0 (-18) | 2 (-17) | 10 (-12) | 24 (-5) | 37 (3) | 47 (8) | 53 (11) | 48 (9) | 41 (5) | 31 (0) | 22 (-5) | 4 (-16) |
| | | | | 74% | 72% | 68% | 58% | 57% | 57% | 57% | 60% | 63% | 67% | 73% | 77% |
| ON | London | 55% | -4 (-20) | -4 (-20) | -2 (-19) | 7 (-14) | 24 (-5) | 35 (2) | 44 (7) | 51 (11) | 47 (9) | 40 (4) | 28 (-2) | 17 (-8) | 3 (-16) |
| | | | | 77% | 74% | 70% | 59% | 55% | 57% | 56% | 59% | 62% | 65% | 74% | 79% |
| | Ottawa | 49% | -12 (-24) | -12 (-24) | -11 (-24) | 0 (-18) | 19 (-7) | 35 (2) | 45 (7) | 52 (11) | 49 (9) | 39 (4) | 30 (-1) | 12 (-11) | -10 (-23) |
| ON | | | | 66% | 61% | 58% | 50% | 49% | 52% | 52% | 55% | 59% | 60% | 69% | 72% |
| | Sudbury | 48% | -18 (-28) | -18 (-28) | -16 (-26) | -3 (-19) | 13 (-11) | 32 (0) | 42 (5) | 50 (10) | 44 (7) | 36 (2) | 27 (-3) | 7 (-14) | -11 (-24) |
| | | | | 71% | 67% | 62% | 54% | 48% | 51% | 51% | 56% | 60% | 64% | 74% | 75% |
| ON | Thunder Bay | 51% | -22 (-30) | -22 (-30) | -20 (-29) | -9 (-23) | 11 (-12) | 28 (-2) | 38 (3) | 44 (7) | 42 (6) | 31 (0) | 22 (-6) | 0 (-18) | -15 (-26) |
| | | | | 63% | 61% | 59% | 51% | 51% | 57% | 58% | 60% | 62% | 62% | 66% | 67% |
| | Toronto | 53% | -4 (-20) | -4 (-20) | -4 (-20) | 3 (-16) | 19 (-7) | 34 (1) | 44 (7) | 50 (10) | 47 (8) | 39 (4) | 30 (-1) | 17 (-8) | -1 (-18) |
| PE | | | | 75% | 72% | 68% | 57% | 54% | 55% | 53% | 56% | 60% | 63% | 73% | 77% |
| | Windsor | 52% | 2 (-17) | 2 (-17) | 6 (-14) | 14 (-10) | 28 (-2) | 39 (4) | 49 (10) | 54 (12) | 53 (12) | 44 (7) | 35 (2) | 21 (-6) | 8 (-13) |
| | | | | 71% | 69% | 64% | 55% | 52% | 54% | 55% | 58% | 59% | 59% | 68% | 74% |
| QC | Charlottetown | 63% | -4 (-20) | -4 (-20) | -2 (-19) | 6 (-15) | 21 (-6) | 31 (0) | 41 (5) | 50 (10) | 48 (9) | 41 (5) | 32 (0) | 20 (-7) | 1 (-17) |
| | | | | 76% | 74% | 74% | 69% | 63% | 65% | 66% | 66% | 66% | 69% | 76% | 79% |
| | Mont Joli | 60% | -11 (-24) | -11 (-24) | -8 (-22) | -1 (-18) | 18 (-8) | 26 (-3) | 41 (5) | 46 (8) | 46 (8) | 35 (2) | 29 (-2) | 14 (-10) | -4 (-20) |
| QC | | | | 73% | 72% | 70% | 67% | 60% | 62% | 64% | 66% | 68% | 69% | 74% | 76% |
| | Montreal | 52% | -13 (-25) | -13 (-25) | -9 (-23) | 1 (-17) | 21 (-6) | 37 (3) | 46 (8) | 53 (12) | 50 (10) | 40 (5) | 31 (-1) | 15 (-10) | -5 (-21) |
| | | | | 69% | 66% | 61% | 55% | 52% | 56% | 55% | 58% | 60% | 62% | 70% | 72% |
| QC | Quebec | 50% | -13 (-25) | -13 (-25) | -13 (-25) | -1 (-19) | 16 (-9) | 31 (0) | 43 (6) | 48 (9) | 46 (8) | 36 (2) | 27 (-3) | 9 (-13) | -7 (-22) |
| | | | | 67% | 64% | 61% | 55% | 50% | 55% | 57% | 59% | 61% | 62% | 70% | 72% |
| | Sept-Iles | 64% | -23 (-31) | -23 (-31) | -17 (-27) | -5 (-21) | 8 (-13) | 25 (-4) | 38 (3) | 45 (7) | 42 (6) | 32 (0) | 22 (-6) | 2 (-17) | -13 (-25) |
| SK | | | | 67% | 64% | 66% | 68% | 65% | 67% | 70% | 70% | 70% | 69% | 71% | 70% |
| | Sherbrooke | 50% | -17 (-27) | -16 (-27) | -17 (-27) | -5 (-21) | 13 (-10) | 31 (0) | 40 (4) | 45 (7) | 42 (5) | 32 (0) | 22 (-5) | 7 (-14) | -12 (-25) |
| | | | | 68% | 61% | 58% | 52% | 50% | 57% | 58% | 62% | 62% | 61% | 71% | 72% |
| YT | Regina | 77% | -31 (-35) | -31 (-35) | -26 (-32) | -13 (-25) | 6 (-15) | 26 (-3) | 37 (3) | 43 (6) | 39 (4) | 24 (-5) | 9 (-13) | -9 (-23) | -27 (-33) |
| | | | | 77% | 80% | 84% | 81% | 77% | 78% | 81% | 80% | 81% | 81% | 83% | 80% |
| | Saskatoon | 74% | -31 (-35) | -31 (-35) | -28 (-34) | -16 (-27) | 7 (-14) | 27 (-3) | 39 (4) | 44 (7) | 41 (5) | 28 (-2) | 10 (-12) | -11 (-24) | -23 (-31) |
| YT | | | | 75% | 77% | 80% | 78% | 74% | 76% | 80% | 80% | 81% | 79% | 81% | 77% |
| | Whitehorse | 38% | -34 (-37) | -34 (-37) | -28 (-34) | -14 (-26) | 3 (-16) | 24 (-5) | 36 (2) | 40 (5) | 36 (2) | 19 (-7) | 3 (-16) | -15 (-26) | -27 (-33) |
| | | | | 72% | 65% | 55% | 46% | 38% | 40% | 46% | 48% | 54% | 63% | 75% | 75% |

Incoming Air Volume

For the humidification load calculation it is assumed that the humidity that must be added is the amount required to bring outdoor air to indoor design conditions. Therefore for any type of air conditioning system the volume of incoming air by mechanical means and infiltration must be determined to obtain an accurate humidification load. The incoming volume depends on the construction of the space being humidified and the type of air conditioning system used. The main types of air conditioning systems are;

Natural Ventilation – In this type of system there is no direct mechanical means for providing fresh outdoor air into the space. The amount of makeup air is calculated based on the volume of the humidified space and an estimate of air changes per hour. Table 7 can be used to estimate the air changes for the four types of construction listed.

Table 7: Air Changes for Natural Ventilation.

| Type of Construction | Air Changes / hour |
|-----------------------------------|--------------------|
| Tight | 0.3 |
| Average | 0.6 |
| Poor | 1 |
| Loose with lots of in/out traffic | 2.5 |

To calculate incoming air volume for natural ventilation calculate the volume of the space being humidified and multiply by air changes/hour from Table 7.

Mixed air system – In this type of system a fixed percentage of the return air is exhausted and replaced with fresh incoming air. The volume of incoming air is what needs to be humidified. The building is generally pressurized however when calculating the load the space should be examined to determine if there is any infiltration possible due to a loose building envelope, large doors in the building envelope, high level of in/out traffic or any other reason. If infiltration is present it should be estimated and added to the incoming air volume provided by the air conditioning system.

Makeup air system – This type of system consists of an air conditioner providing fresh incoming with no return air. The entire volume of the air conditioning system must be humidified to bring it to the design condition. The building is generally pressurized however as with a Mixed air system the building should be examined to determine if infiltration is present. Any infiltration should be added to the incoming air volume.

Exhaust air system - In this type of system a fixed volume of air is exhausted from the building. The incoming air volume must be at least equal to the volume of exhausted air and is what needs to be humidified. As with the mixed air system and makeup air system the building should be examined to determine if any additional infiltration is present and the volume of infiltration added to the incoming air volume.

Note:

For all mechanical air conditioning systems the space being humidified should be examined to determine if there is any infiltration possible due to loose building envelope, large doors in the building envelope, high level of in/out traffic or any other reason. If infiltration is present it should be added to the incoming air volume calculated by mechanical means.



Load Calculations

Natural Ventilation

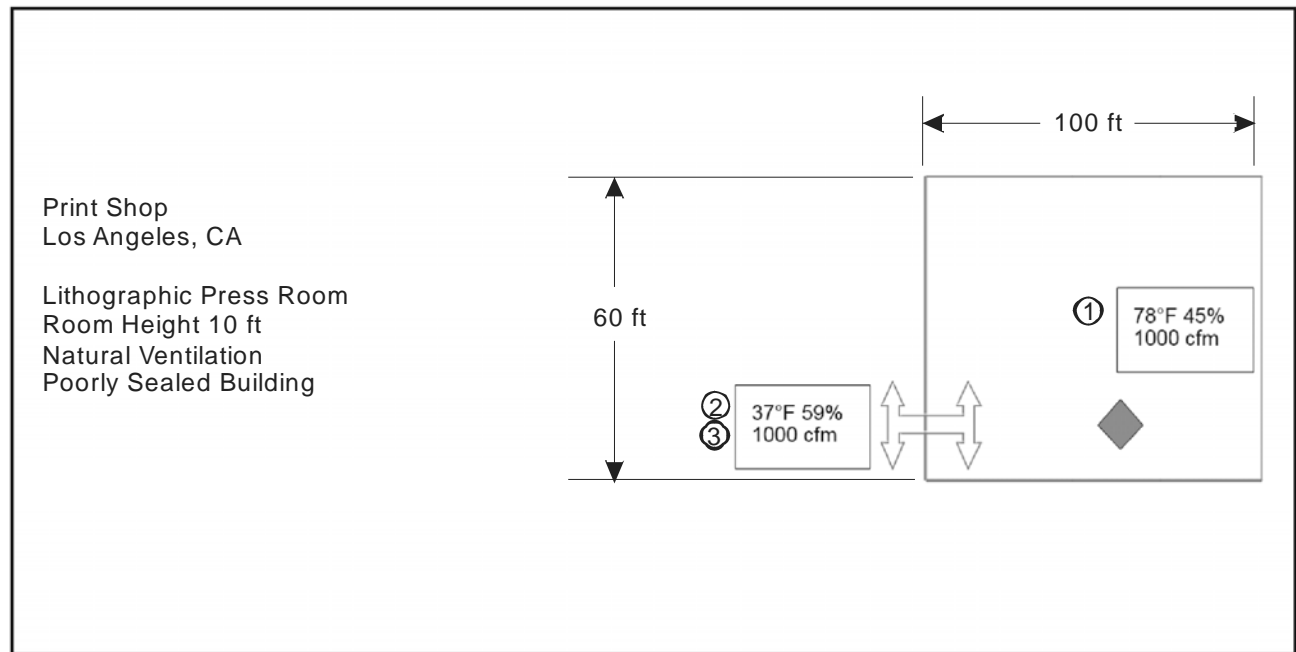


Figure 5: Print Shop, Los Angeles California, Natural Ventilation

Example 3: Load Calculation Natural Ventilation - Figure 5 shows a schematic from HELP depicting a print shop in Los Angeles that is poorly sealed with a volume of 60 ft x 100 ft x 10 ft.

- 1 Get design condition for Printing – Lithographic Press from Table 4 (assume design condition is the middle of the range). Calculate the moisture content using method given in Calculating Relative Humidity on page 10.

Design Condition = 78°F and 45% RH

$$A = 0.00149 \text{ lb/cu.ft}$$

From Table 2

$$B = A \times 45\% / 100\% = 0.00149 \times 0.45 = 0.000671 \text{ lb/cu.ft}$$

At 45% RH

- 2 Get incoming air conditions for Los Angeles from Table 5: Weather Data - United States. Calculate the moisture content at the incoming air condition.

Incoming Air Conditions = 37°F, 59% RH.

From Table 5

$$C = 0.000366 \text{ lb/cu.ft}$$

From Table 2

$$D = C \times 59\% / 100\% = 0.000366 \times 0.59 = 0.000216 \text{ lb/cu.ft}$$

At 59% RH

- 3 Subtract the moisture content of incoming air from moisture content at design condition to get moisture which must be added per cu.ft

$$E = B - D = 0.000671 - 0.000216 = 0.000455 \text{ lb/cu.ft}$$

- 4 Calculate the volume of incoming air for a poorly sealed building.

$$V = 100 \text{ ft} \times 60 \text{ ft} \times 10 \text{ ft} = 60,000 \text{ cu.ft}$$

Volume of the space

$$\text{Air changes / hr} = 1$$

From Table 7

$$V_{\text{Incoming}} = V \times \text{Air Changes} = 60,000 \times 1 = 60,000 \text{ cu.ft/hr}$$

- 5 Calculate humidification load by multiplying moisture to be added by incoming air volume.

$$L = E \times V_{\text{Incoming}} = 0.000455 \text{ lb/cu.ft} \times 60,000 \text{ cu.ft/hr} = 27 \text{ lb/hr}$$

Humidification Load

Mixed Air System

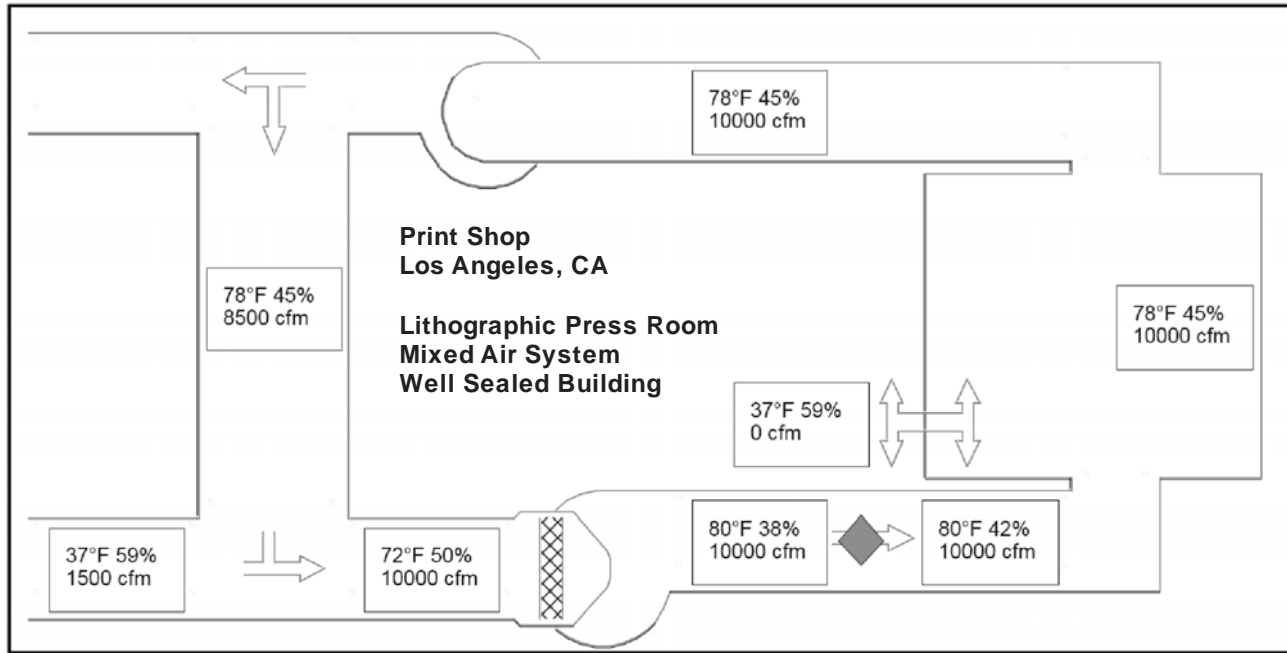


Figure 6: Print Shop, Los Angeles California, Mixed Air System

Example 4: Load Calculation Mixed Air System - Figure 6 shows a schematic from HELP depicting a print shop in Los Angeles with a Mixed Air System. The mixed air system provides 15% makeup air and this building is well sealed.

- 1 Since design conditions and incoming air conditions are the same as in the previous example the moisture which must be added is the same (Steps 1, 2, and 3).

$$E = 0.000455 \text{ lb/cu.ft}$$

Moisture which must be added

- 2 Calculate the volume of incoming air per hour with 15% makeup air shown in the illustration.. Since this building is well sealed we will assume infiltration will be 0 cfm.

$$V_{\text{Incoming}} = V_{\text{Return Air}} \times 15\% / 100\% = 10,000 \text{ cfm} \times 15\% / 100\% = 1,500 \text{ cfm}$$

$$V_{\text{Incoming}} = 1,500 \text{ cu.ft/min} \times 60 \text{ min} / \text{hr} = 90,000 \text{ cu.ft/hr}$$

- 3 Calculate humidification load by multiplying moisture which must be added by incoming air volume.

$$L = E \times V_{\text{Incoming}} = 0.000455 \text{ lb/cu.ft} \times 90,000 \text{ cu.ft/hr} = 41 \text{ lb/hr}$$

Humidification Load

Makeup or Exhaust Air System

The load calculation for a Makeup Air System, or an Exhaust Air System, are the same as for a mixed air system except that all the air moving through the system must be humidified. For the example above with no return air the load would be calculated as follows.

- 1 The moisture which must be added is the same.

$$E = 0.000455 \text{ lb/cu.ft}$$

- 2 The entire volume of 10,000 cfm must be humidified so volume per hour is;

$$V_{\text{Incoming}} = 10,000 \text{ cu.ft/min} \times 60 \text{ min} / \text{hr} = 600,000 \text{ cu.ft/hr}$$

- 3 Calculate humidification load by multiplying moisture to be added by incoming air volume.

$$L = E \times V_{\text{Incoming}} = 0.000455 \text{ lb/cu.ft} \times 600,000 \text{ cu.ft/hr} = 273 \text{ lb/hr}$$

Humidification Load

Economizer Cycles

Care should be taken in sizing humidification load when an economizer cycle is incorporated into a building HVAC system. Under normal heating conditions the makeup air volume is usually relatively small to avoid heating large amounts of outside air. However when the economizer cycle is in operation the makeup air volume may be as high as 100% of the supply air volume.

To calculate the humidification load for a system with an economizer cycle the load must be calculated for each month in which the economizer mode may operate. The calculations are performed using a low temperature for each month and the average humidity. The monthly values for the calculation are given in Table 6: Weather Data – Canada and Table 5: Weather Data - United States in the columns under “Economizer Calculation”.

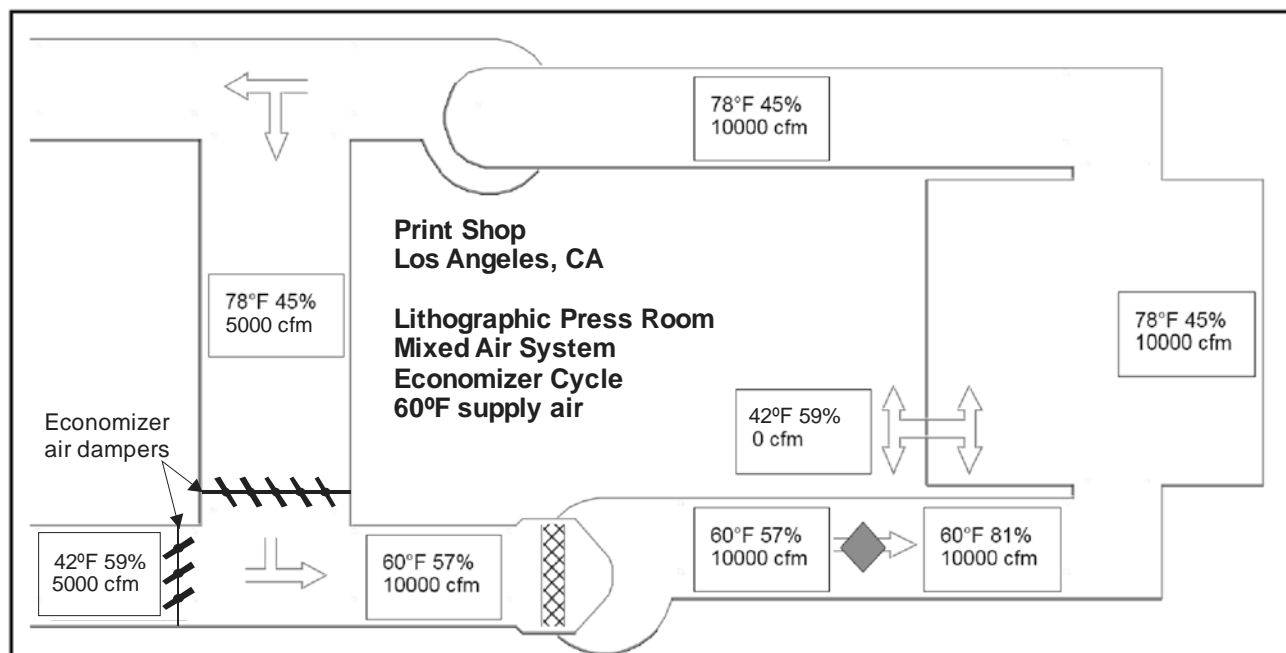


Figure 7: Economizer Cycle with 100% Makeup Air

Example 5: Load Calculation Economizer Cycle - Figure 7 shows the print shop in Los Angeles California for the condition which HELP software has determined will be the maximum economizer cycle humidification load . The supply air temperature for the economizer cycle is 60°F. The following example shows how to manually calculate the maximum humidification load for a system with an economizer cycle.

- 1** Create a table listing the months (column A) that the economizer may be active with headings as shown in Table 8. In this case all 12 months are listed.
- 2** Get the relative humidity (column B) and temperature (column C) for each month from the columns under “Economizer Calculation” in Table 5.
- 3** Calculate the moisture content of the Outdoor Air (column D and E) for each month using the method outlined in Calculating Relative Humidity on page 10.
- 4** Calculate the moisture content at the 78°F 45% RH design conditions (Column F) using the method outlined in Calculating Relative Humidity on page 10.
- 5** Calculate the moisture that must be added to the outdoor air (Column G) by subtracting moisture content of outdoor air from moisture content at design conditions.

- 6 Calculate the percentage outdoor air that economizer cycle will use (column H) to obtain the supply air temperature of 60°F using the formula;

$$\% \text{ Outdoor Air} = \frac{(T_s - T_d)}{(T_{od} - T_d)} \times 100\%$$

Where: T_s = Supply air temperature

T_d = Design temperature

T_{od} = Outdoor air temperature

- 7 Calculate the Incoming Air Volume that must be humidified each hour (column I) by multiplying the air handler volume in cu.ft/hr x % Outdoor Air.

$$V = \text{Air Handler Volume cu.ft/min} \times \% \text{ Outdoor Air} \times 60 \text{ min/hr}$$

- 8 Calculate the humidification load (column J) for each month by multiplying the hourly air volume by the moisture that must be added.

Table 8: Economizer Load Calculation, Los Angeles

| A | B | C | D | E | F | G | H | I | J |
|-------|-----------------|-----------------|--|--|----------------------------|-----------------------------|--------------------------------|------------------------------|---------------------|
| Month | Outdoor RH | Outdoor Temp | Outdoor Air Moisture content at Outdoor temp and 100% RH | Outdoor Air Moisture content at Outdoor RH | Design Moisture Content | Moisture that must be added | Required % Incoming Air Volume | Required Incoming Air Volume | Humidification Load |
| | (from Table 10) | (from Table 10) | (from table 6) | (B x D) | (from table 6 x Design RH) | (F - E) | $(T_s - T_d) / (T_{od} - T_d)$ | (H x Volume) | (G x I) |
| | % | °F | Lb/cu.ft | lb/cu.ft | lb/cu.ft | lb/cu.ft | % | cu.ft/hr | lb/hr |
| Jan | 59 | 37 | 0.000366 | 0.000216 | 0.000671 | 0.000455 | 44% | 263415 | 119.9 |
| Feb | 63 | 43 | 0.000457 | 0.000288 | | 0.000383 | 51% | 308571 | 118.2 |
| Mar | 65 | 44 | 0.000474 | 0.000308 | | 0.000363 | 53% | 317647 | 115.3 |
| April | 64 | 48 | 0.000547 | 0.000350 | | 0.000321 | 60% | 360000 | 115.5 |
| May | 66 | 52 | 0.000630 | 0.000416 | | 0.000255 | 69% | 415385 | 106.0 |
| June | 67 | 56 | 0.000723 | 0.000484 | | 0.000187 | 82% | 490909 | 91.6 |
| July | 68 | 58 | 0.000773 | 0.000526 | | 0.000145 | 90% | 540000 | 78.5 |
| Aug | 69 | 60 | 0.000829 | 0.000572 | | 0.000099 | 100% | 600000 | 59.4 |
| Sept | 67 | 57 | 0.000747 | 0.000500 | | 0.000171 | 86% | 514286 | 87.7 |
| Oct | 65 | 52 | 0.000630 | 0.000410 | | 0.000262 | 69% | 415385 | 108.6 |
| Nov | 61 | 45 | 0.000491 | 0.000300 | | 0.000371 | 55% | 327273 | 121.3 |
| Dec | 59 | 42 | 0.000440 | 0.000260 | | 0.000411 | 50% | 300000 | 123.4 |

Obtain the maximum humidification load with an economizer cycle from column J. In this case it will be 123.4 lb/hr and will occur in December if the economizer draws 50% outdoor air.

Note:

- The energy saving function of the economizer cycle may be defeated if the humidification cost exceeds the energy saved by the cycles free cooling.
- Maximum humidification load does not occur at the 100% makeup air condition in August because of the high moisture content of the outdoor air in that month.



U.S.A.

Walter Meier (Climate USA) Inc.
826 Proctor Avenue
Ogdensburg, NY 13669

CANADA

Walter Meier (Climate Canada) Ltd.
2740 Fenton Road
Ottawa, Ontario K1T 3T7

TEL: 1.866.NORTEC1
FAX: 613.822.7964

EMAIL: nortec@waltermeier.com
WEBSITE: www.humidity.com

www.norteconline.com



**walter
meier**